

**MOD JSP 375 VOLUME 3**  
**CHAPTER 5**

**PETROLEUM INSTALLATIONS**

## Amendments

Amendment No.	Pages affected	Date	Entered By
Updated	Foreword	October 2014	SAA (Petroleum)
Paragraphs 1.2.4, 1.3.2(a), 1.3.4 and 1.3.5 wording change	Introduction pages 1 and 2	October 2014	SAA (Petroleum)
Paragraphs 2.2.2, 2.3.2 (a,g,h,l,k) and 2.4.4 (a,b,c,d,e,f,h,i,j) removed – incorporated in Chapter 2	Roles & Responsibilities Page 3	October 2014	SAA (Petroleum)
Paragraphs 3.1.2, 3.1.3 and 3.1.4 removed – incorporated in Chapter 2	General Arrangements Page 5	October 2014	SAA (Petroleum)
Paragraph 4.2.2(j) removed	Management Arrangements Page 6	October 2014	SAA (Petroleum)
Paragraph 4.2.4 added	Management Arrangements Page 6	October 2014	SAA (Petroleum)
Paragraph 4.3.3 (d) suspension added	Management Arrangements Page 7	October 2014	SAA (Petroleum)
Paragraph 4.5.1 removed – incorporated in Chapter 2	Management Arrangements Page 7	October 2014	SAA (Petroleum)
Paragraph 5.3.1(j) Emergency Rescue Plan added	Operational Procedures Page 10	October 2014	SAA (Petroleum)
Paragraph 5.4: - Naval Diesels removed - AVCAT controlled by RA & SI - RA statement added in comment box	Operational Procedures Decision Tree Page 11	October 2014	SAA (Petroleum)
Paragraph 5.6.2, 5.6.5, 5.6.13 and 5.8.10 wording amended to verify system integrity	Operational Procedures Pages 12, 13 and 15	October 2014	SAA (Petroleum)
Paragraph 5.6.11 added	Operational Procedures Page 13	October 2014	SAA (Petroleum)
Paragraph 5.8.14 (i) 'Electrical storm' added	Operational Procedures Page 15	October 2014	SAA (Petroleum)
Paragraph 5.8.17 and 5.10 amended to reflect changes PTW & SP	Operational Procedures Flow Diagrams pages 16, 17 and 19	October 2014	SAA (Petroleum)
Paragraph 5.9.4 amended to reflect change in decision tree	Operational Procedures Page 18	October 2014	SAA (Petroleum)
Paragraph 5.10 revised to reflect changes to Standing Instruction	Operational Procedures Pages 19 and 20	October 2014	SAA (Petroleum)
Section 6 Updated	Training Pages 21 and 22	October 2014	SAA (Petroleum)
Paragraph A1.4 wording added.	Annex A		
Paragraphs B2, B7(c) B8.1.1 9 (c) B8.1.3, B8.2.1, B8.2.2, B9 and flow diagram amended	Annex B	October 2014	SAA (Petroleum)
Paragraph C4.1 amended to include HSE requirements	Annex C	October 2014	SAA (Petroleum)
Paragraph D.1 and D2.3 amended	Annex D	October 2014	SAA (Petroleum)
Paragraph E 3.3 (d) wording added	Annex E		
Removed	Annex G	October 2014	SAA (Petroleum)
Paragraph G2 (a,b,c) amended, G3 'significant' changed to 'principal'	Annex H now Annex G	October 2014	SAA (Petroleum)
Paragraph G5.4 added	Annex H now Annex G	October 2014	SAA (Petroleum)
References removed	Annex H now Annex I	October 2014	SAA (Petroleum)
Paragraph J 2.1 wording added, J2.3 removed	Annex I now Annex J	October 2014	SAA (Petroleum)
Paragraph 1.2 Flashpoint definition changed, hazardous Area paragraphs 1 & 2 amended, demarcation definition added	Annex L now Annex K	October 2014	SAA (Petroleum)
Changed to landscape format	Model form PET 01	October 2014	SAA (Petroleum)
Part 4. 'Cancellation' added	Model form PET 05	October 2014	SAA (Petroleum)
Amended	Model form PET 06	October 2014	SAA (Petroleum)
Removed	Model form PET 07	October 2014	SAA (Petroleum)
Amended to reflect changes in Chapter 5	Safety Rule Book	October 2014	SAA (Petroleum)

Sponsored by: Defence Infrastructure Organisation  
 Engineering and Construction

## Contents

Section	Topic	Page
	<b>Amendments</b>	i
	<b>Contents</b>	ii
	<b>Foreword</b>	iv
<b>PART 1 - RULES AND PROCEDURES</b>		
1	<b><u>Introduction</u></b>	1
1.1	General	1
1.2	Concept of Operations	1
1.3	Scope and Limitations	1
1.4	Definitions	2
2	<b><u>Roles &amp; Duties</u></b>	3
2.1	General	3
2.2	Authorising Engineers (Petroleum)	3
2.3	Authorised Persons (Petroleum)	3
2.4	Persons in Charge (Petroleum)	4
2.5	Work Team	4
2.6	Operating Authority	4
3	<b><u>General Arrangements</u></b>	5
3.1	General	5
3.2	Site Review	5
3.3	Demarcation Agreement	5
4	<b><u>Management Arrangements</u></b>	6
4.1	Petroleum Installations Document Centre	6
4.2	Petroleum Installations Document Register	6
4.3	Petroleum Installations Operating Record	7
4.4	Keys & Key Security	7
4.5	Management of Remote Sites	7
4.6	Notification Regime	7
4.7	Co-ordination and Co-operation of Activities	8
4.8	Petroleum Safety Rule Book	8
5	<b><u>Operational Procedures</u></b>	9
5.1	General	9
5.2	Risk Assessment	9
5.3	Method Statement	10
5.4	Determining the Level of Control	10
5.5	Restricted Area	12
5.6	Safety Programme	12
5.7	Permit to Work	13
5.8	Issue, Acceptance, Suspension, Reaffirmation and Cancellation of Permits to Work	14
5.9	Standing Instruction	18
5.10	Issue, Acceptance and Cancellation of Standing Instructions	19
6	<b><u>Training</u></b>	21
6.1	Introduction	21
6.2	Authorising Engineer (Petroleum)	21

6.3	Authorised Person (Petroleum)	21
6.4	Training Content	21
	<a href="#"><u>Acknowledgements</u></a>	27

## PART 2 - SUPPORTING GUIDANCE

<b>Annex</b>	<b>Subject</b>
<a href="#"><u>A</u></a>	Isolation Methodology
<a href="#"><u>B</u></a>	Electrical works in Petroleum Hazardous Areas
<a href="#"><u>C</u></a>	Gas Detection and Monitoring
<a href="#"><u>D</u></a>	Personal Protective Equipment and Respiratory Protective Equipment
<a href="#"><u>E</u></a>	Guidance on Grass Cutting
<a href="#"><u>F</u></a>	Guidance on Restricted Areas
<a href="#"><u>G</u></a>	AP Petroleum Risk Assessment
<a href="#"><u>H</u></a>	Medical Requirements
<a href="#"><u>I</u></a>	Signs, Notices and Posters
<a href="#"><u>J</u></a>	Works Organisation at Product Receipt Enclosure
<a href="#"><u>K</u></a>	Definitions

## PART 3 - MODEL FORMS

<b>Form</b>	<b>Subject</b>
<a href="#"><u>PET 01</u></a>	Petroleum Installation Operating Record (PIOR)
<a href="#"><u>PET 02</u></a>	AP Risk Assessment
<a href="#"><u>PET 03</u></a>	Safety Programme
<a href="#"><u>PET 04</u></a>	Permit to Work Petroleum
<a href="#"><u>PET 05</u></a>	Standing Instruction Petroleum
<a href="#"><u>PET 06</u></a>	Petroleum Works Safety Checklist

## Foreword

This Chapter of JSP 375, Volume 3 was prepared under the patronage of the Ministry of Defence (MOD) Director of Defence Safety and Environmental Authority (DSEA) and is to be read in conjunction with JSP 375 Volume 3 Chapter 2 – Common Requirements. These Safety Rules and Procedures are mandatory for adoption by the Commanding Officer, Chief Executive or Head of Establishment, into their site safety plans, to secure compliance with the Health & Safety at Work Act and to aid the safe conduct of works activities.

The adoption of the document into the site safety plan will influence the conduct of many organisations and personnel, including those whose responsibilities are defined in the Common Requirements, as follows:

- Site Safety Officer
- Senior Infrastructure Manager
- Infrastructure Manager
- Establishment Works Consultant (where this duty is still extant)
- Works Service Management organisation and other Maintenance Management Organisations, other Contractors and Sub-contractors
- Facilities Managers, Project Sponsors, Project Managers and Contractors for Projects
- Designers of facilities and installations
- Operators of fuel installations

Technical advice and assistance on the application of this document can be obtained from the Senior Authorising Authority (Petroleum)

Amendments to this publication will be advised by a Defence Information Notice or a Defence Infrastructure Organisation (DIO) ES&P Policy Instruction issued to MOD Top Level Budget Holders, DIO and organisations managing the MOD Safe Systems of Work. It is the responsibility of persons using this publication on any MOD Establishment to check with the Facilities Manager or Project Sponsor to ascertain if amendments have been issued.

JSP 375 Volume 3 has been devised for the use of MOD and its contractors in the execution of works in relation to the MOD estate. The Crown hereby excludes all liability (other than liability for death or personal injury) whatsoever and howsoever arising (including, and without limitation, negligence on the part of the Crown its servants or agents) for any loss or damage however caused where the Standard (JSP 375 Volume 3) is used for any other purpose.

Compliance with either this Chapter or Chapter 2 Common Requirements does not of itself confer immunity from legal obligations. In the case of conflict between these Safety Rules and Procedures and a Statutory Requirement becoming evident, DDSEA and the SAA Petroleum are to be informed. Contact addresses are given below.

DDSEA  
Director of Defence Safety and Environment Authority  
MOD Main Building  
Whitehall  
London  
SW1A 2HB

SAA Petroleum  
Defence Infrastructure Organisation  
Kingston Road  
Sutton Coldfield  
B75 7RL

# **PART 1**

# **RULES AND PROCEDURES**

# 1. Introduction

## 1.1. General

- 1.1.1 These Safety Rules and Procedures provide instruction on how work on 'Petroleum Installations' is to be managed on sites and in work situations which are under the control of the Ministry of Defence (MOD). They are to be read in conjunction with MOD Safety Rules and Procedures JSP 375 Volume 3 and related Chapters.
- 1.1.2 For the purpose of these Safety Rules and Procedures, 'Petroleum Installations' incorporate those detailed in section 1.3 Scope and Limitations.
- 1.1.3 This document provides a system for:
- Controlling work on Petroleum Installations
  - Minimising the risks associated with working on Petroleum Installations
  - Defining the roles and duties of key individuals to manage, oversee and perform any such work
  - The application of these Safety Rules and Procedures
- 1.1.4 The Authorising Engineer (AE) is to obtain written approval for any deviation or for the use of a local version from the Senior Authorising Authority (SAA).

## 1.2 Concept of Operations

- 1.2.1 These Safety Rules and Procedures mandate the establishment of key individuals with specific responsibilities for the management and / or execution of work on Petroleum Installations. Further guidance on the roles and duties of these appointments is given in JSP 375 Volume 3 Chapter 2 – Common Requirements.
- 1.2.2 The line manager of the Fuels and Lubricants section hereby known as the Operating Authority (OA) has delegated authority for the installations, in accordance with the current version of JSP 317. Authority must be given by the Operating Authority before any works can be undertaken on a Petroleum Installation.
- 1.2.3 The application of these rules is the responsibility of all those, operating, working on, testing, decommissioning, ordering, specifying and designing Petroleum Installations or associated equipment.
- 1.2.4 Further reference should also be made to the current version of JSP 317, The Storage and Handling of Fuels and Lubricants.

## 1.3 Scope and Limitations

- 1.3.1 These Safety Rules and Procedures are designed for use on MOD Establishments, both in the UK and overseas.
- 1.3.2 These Safety Rules and Procedures include and are not limited to the following permanent fixed installations:
- Packed Stock Storage – Including flammable dangerous goods stores
  - Mechanical Transport Fuelling Installations
  - Aviation Fuelling and Distribution Installations
  - Marine Ship to Shore Fuelling
  - Petroleum Supply Depots
  - Class II Boiler and Generator Fuels

- g. Class III Boiler and Generator Fuels
- h. Waste Petroleum Product Storage
- i. Hot Fire Training Rigs using Class II Fuel

1.3.3 The Petroleum Installations listed above may include the following:

- a. Storage tanks
- b. Product receipt pipelines and filtration
- c. Transfer pipelines including floating hoses and subsea pipelines
- d. Dispense/receipt points to road vehicles
- e. Rail facilities
- f. Pump house/filter water separators and filter monitors
- g. Roads, vehicle hard standing / interception and drainage oil separators
- h. Valve pits
- i. Hydrant distribution systems
- j. Pipe line end manifolds

1.3.4 Ancillary installations (Class II and III) serving boilers and generator houses involving low risk activities are not within the scope of this Chapter. Low risk activities on boiler fuel oil installations unless these have their own demarcation agreements in place shall be managed under JSP 375, Volume 3 Chapter 4.

All work shall be risk assessed. Activities identified as high risk such as hot work or confined space entry shall be deemed as being within the scope of this Chapter.

1.3.5 Petroleum Installations concerning Service Family Accommodation are outside the scope of this Chapter. All work shall be risk assessed and managed under current industry standards and guidance.

## **1.4 Definitions**

1.4.1 Within this Chapter the terms Authorising Engineer and Authorised Person refer to 'Authorising Engineer' (Petroleum) and 'Authorised Person' (Petroleum) and no other related specialism. Other related specialism's will be written out in full e.g. Authorised Person (Electrical).

1.4.2 Other relevant definitions are provided in JSP 375 Volume 3 Chapter 2.



## 2. Roles & Duties

### 2.1 General

2.1.1 This section discusses the principal roles and duties of those involved in the management of the Safe System of Work. These are identified as follows:

- a. The Co-ordinating Senior Authorising Authority (CSAA)
- b. The Senior Authorising Authority (SAA)
- c. The Co-ordinating Authorising Engineer (CAE)
- d. The Authorising Engineer (AE)
- e. The Authorised Person (AP)
- f. The Person in Charge (PiC)
- g. The Skilled Person (SkP)
- h. Works Team
- i. Operating Authority (OA)

2.1.2 Unless otherwise defined in this Chapter the general roles and duties of all individuals listed in paragraph 2.1.1 above are covered in JSP 375 Volume 3 Chapter 2 (with the exception of the OA, whose general roles and duties are contained in JSP 317). The purpose of this section is to identify any specific and/or additional roles and duties connected with the management of work on Petroleum Installations.

### 2.2 Authorising Engineer

2.2.1 The role of the AE is to implement, administer, monitor and audit these Safety Rules and Procedures.

2.2.2 Duties of the AE are detailed in JSP 375 Volume 3 Chapter 2. In addition, duties of the AE include:

- a. approval of the site notification regime

### 2.3 Authorised Person

2.3.1 The AP is to implement this safe system of work on Petroleum Installations for which they have been appointed.

2.3.2 Duties of the AP are detailed in JSP 375 Volume 3 Chapter 2. In addition, duties of the AP include:

- a. Communication with the OA of the Petroleum Installation at the work planning stage
- b. Preparing an AP Risk Assessment
- c. Preparing a Safety Programme to ensure adequate control of a Petroleum Installation prior to the issue of any Permits to Work for that installation
- d. Defining the condition of the petroleum installation that is required immediately before planned works can commence
- e. Acceptance of Petroleum Installation from the OA for the purpose of planned works
- f. Handing over of a Petroleum Installation to the OA on completion of work
- g. Production of a Site Review

## **2.4 Person in Charge**

- 2.4.1 The role of the Person in Charge (PiC) is to directly supervise (or carry out) work on a Petroleum Installation for which they are in receipt of a Permit to Work or Standing Instruction.
- 2.4.2 Duties of the PiC are detailed in JSP 375 Volume 3 Chapter 2. In addition, duties of the PiC include:
  - a. To monitor and record gas levels in accordance with the requirement of each Permit to Work

## **2.5 Work Team**

- 2.5.1 The PiC must be a SkP for the installation for which the Permit to Work or Standing Instruction is to be issued. Duties of a SkP are detailed in JSP 375 Volume 3 Chapter 2.
- 2.5.2 The full work team does not necessarily need to completely comprise of registered SkPs.
- 2.5.3 Duties of the work team include:
  - a. Complying with these Safety Rules and Procedures as set out in this chapter
  - b. Taking reasonable care of the health and safety of themselves and duty of care of any other person who may be affected by their actions or omissions
  - c. Only using equipment for which they have been trained and in the manner in which they have been trained
  - d. Reporting to the PiC/AP any defects found in the tools, plant and equipment to be used in the works
  - e. Reporting to the PiC/AP any defects identified with the equipment being worked on
  - f. Being conversant with petroleum hazards
  - g. Understanding the management hierarchy relating to the site installations

## **2.6 Operating Authority**

- 2.6.1 The OA has the authority delegated by the Commanding Officer, Head of Establishment or Officer in Charge for one or a number of Petroleum Installations. The OA is required to exercise duty of care over all activities at the installations and ensure that petroleum and base wide operations are fully taken into account before the AP is given authority to undertake work.
- 2.6.2 Duties of the OA include:
  - a. Agree a Notification Regime procedure with the AP.
  - b. Inform their staff of the work, any limitations imposed by the work and carry out any actions required of the OA by the AP prior to handing over the installation or equipment.
  - c. Sign Part 2 of the Safety Programme as the final authorisation for the work to proceed.
  - d. Sign Part 5 of the Safety Programme to confirm the return of the installation for normal operations.
  - e. Implement a key access procedure to areas under their control.
  - f. Co-ordinate tasks on Petroleum Installations carried out by organisations other than the MMO.
  - g. Link all activities undertaken in the Petroleum Installations with the establishment wide system for safe control and co-ordination of operations and works activities.
  - h. Sign the Standing Instruction for the work to proceed.

## **3. General Arrangements**

### **3.1 General**

- 3.1.1 Compliance with these Safety Rules and Procedures is mandatory for work on Petroleum Installations, under the control of the Ministry of Defence (except where agreed with the SAA) from initial specification and design, through installation operation and eventual decommissioning. The design must incorporate adequate means for safe isolation and draining of the equipment. Consideration must be given to the needs of the operator, AP and maintainer of the plant to enable safe working. Changes made to the original design, as a result of site alterations, must not compromise safe working and preserve the ability for safe isolation. The Project Manager in charge of the works is to ensure that any alterations made on site does affect the application of these Safety, Rules and Procedures.

### **3.2 Site Review**

- 3.2.1 A record of Petroleum Installations on an establishment that are subject to the application of these Safety Rules and Procedures is to be provided and held in the Petroleum Installation Document Register (PIDR). An appraisal is to be undertaken by any new AE, or APs as part of their familiarisation. A review of this record is to be undertaken following any changes or modifications to the Petroleum Installations. The review is to be recorded in the Petroleum Installations Operating Record (PIOR).

- 3.2.2 The review is to consider the classification and hazards for each installation. This should be undertaken in conjunction with the decision tree detailed in Section 5.4. Should the AE consider that a higher level of control is required on a particular installation, this should be detailed within the PIOR, documented in the PIDR and communicated to the APs. The following areas should be considered:

- a. Product
- b. Flammability
- c. Toxicity
- d. Location
- e. Size
- f. Quantity of product held
- g. Complexity
- h. Potential environmental impact
- i. Maintenance regime
- j. Operational duties
- k. Age
- l. Condition
- m. Records, drawings and instructions
- n. Outstanding remedial works

- 3.2.3 The AE may determine that other fuel related systems pose hazards that require control by the implementation of these Safety Rules and Procedures (e.g. aviation fuel systems test houses, engine test houses and unclassified fuels). Details of these additional systems are to be recorded and filed in the PIDR and included on the APs appointment.

### **3.3 Demarcation Agreements**

- 3.3.1 These Safety Rules and Procedures shall apply on all works where there remains a petroleum hazard, unless these installations have their own demarcation agreements in place. Where it has been agreed that no petroleum hazard remains, the works may fall

outside of Chapter 5. Those controlling the work are to note that all works must be risk assessed and other sections of JSP 375 may apply.

## 4. Management Arrangements

### 4.1 Petroleum Installations Document Centre

4.1.1 The requirements for the Document Centre are detailed in JSP 375, Volume 3 Chapter 2.

### 4.2 Petroleum Installations Document Register

4.2.1 The Petroleum Installations Document Register (PIDR) is the principal source of management information for Petroleum Installations within the site, location or geographical area and is to be maintained by the APs.

4.2.2 The PIDR will contain the following information where it is relevant:

- a. An index
- b. A detailed record of Petroleum Installations/systems subjected to the application of these Safety Rules and Procedures – Site Review
- c. Details of all redundant or abandoned tanks on site
- d. Demarcation agreements agreed and accepted by the AE
- e. Planned maintenance regime
- f. A schedule of Personal Protective Equipment (PPE), Respiratory Protective Equipment (RPE) and Safety Equipment held and maintained relating to the Petroleum discipline
- g. OA notification regime and OA details
- h. Safety Data Sheets (product or material SDS)
- i. Relevant, current publications (MoD, HSE, Industry standard)
- j. Records of the examination/calibration of PPE, RPE and other Safety Equipment
- k. The number of hours in use of all PPE, RPE for all MMO site held equipment
- l. Duplicate Permits to Work (can be held in pad)
- m. Completed Safety Programmes and Risk Assessments
- n. Standing Instructions (can be held in pad)
- o. Cancelled Permits to Work
- p. Cancelled Standing Instructions
- q. Copies of Professional Inspection reports
- r. Any previous reports which may assist in assessing whether the petroleum system is safe to operate
- s. Relevant information on repairs
- t. Petroleum system schematics, DSEAR risk assessments, hazardous zone drawings and valve identification charts where determined necessary by the AE
- u. Any relevant Policy Instruction, Defence Instruction Notice (DIN), Operational Restriction, Safety Alert, AE Instruction, as directed by the AE
- v. Unit Spillage Response Plan
- w. AE/AP appointment information
- x. Skilled Person Register and assessment information
- y. AE audit reports

4.2.3 Where documents noted above are held elsewhere, their location is to be identified in the relevant section of the Document Register.

4.2.4 Safety Documentation is to be retained for a minimum period of three years.

### 4.3 Petroleum Installations Operating Record (PIOR)

4.3.1 For each site, location or geographical area, as determined by the AE, a PIOR is to be

prepared. This is to be in the form of a bound book, with pages sequentially numbered. The book is to be clearly and indelibly marked with the name of the site/location or geographical area to which the records relate.

4.3.2 The AE may determine that it be preferable to have a separate PIOR for distinctly separate installations.

4.3.3 Entries are to be made within the PIOR of any activity undertaken with respect to a Petroleum Installation (as defined by these Safety Rules and Procedures). These entries are to include:

- a. The relinquishing and acceptance of responsibility between APs
- b. The isolation of any Petroleum Installation (or part of a system) in accordance with a Safety Programme and Risk Assessment; this is to make reference to the Safety Programme and Risk Assessment and not repeat all steps from the Safety Programme
- c. When Multiple Gas Indicators are response tested, to include the make and serial number of the instrument, and a satisfactory or non-satisfactory result
- d. The issue, suspension, re-affirmation and cancellation of each Permit to Work or Standing Instruction
- e. The loss of a Permit to Work or Standing Instruction
- f. The withdrawal of a Permit to Work or Standing Instruction including the reason for withdrawal
- g. The re-instatement of any Petroleum Installation (or part of a system) following the completion of all works and the closure of the Permit to Work or Standing Instruction
- h. Details of any reportable disease, injury, dangerous occurrence, near miss and spill reports associated with work on Petroleum Installations where controlled by the AP
- i. Any change of the product in a petroleum storage system
- j. AE visit, audit or inspection
- k. SAA visit, Assurance audit or inspection
- l. Receipt of relevant Policy Instruction, Defence Instruction Notice (DIN), Operational Restriction, Safety Alert, AE Instruction and resulting action taken in response to the receipt
- m. Transfer of responsibility and cancellation of demarcations

4.3.4 Entries in the PIOR are to be made in chronological order, each entry being ruled off with a horizontal line across the page. A sample format for the PIOR is given in Part 2 Model Forms.

4.3.5 Completed PIORs are to be retained in the Petroleum Installations Document Centre for a minimum period of three years after the date of the last entry.

#### **4.4 Keys & Key Security**

4.4.1 The use of safety key boxes, safety locks and other types of locks in the management of these Safety Rules and Procedures are detailed in JSP 375 Volume 3 Chapter 2.

#### **4.5 Management of Remote Sites**

4.5.1 Refer to JSP 375 Volume 3 Chapter 2.

#### **4.6 Notification Regime**

4.6.1 A formal notification regime is to be implemented between the OA and the APs. For each site the AE is to approve the notification regime to ensure control and co-ordination is achieved on current and planned works requiring the application of these Safety Rules and Procedures. The regime is to be formally agreed by the MMO and OA. Details of the regime are to be held in the PIDR.

#### **4.7 Co-ordination and Co-operation of Activities**

- 4.7.1 Where work involves APs from different disciplines, the AP Petroleum is to co-ordinate the activities of the APs of all other disciplines.
- 4.7.2 In exceptional circumstances, and only where approved by the AE, where it is beyond the capacity of the AP to raise the required safety documents and provided there is no conflict between the activities then a second AP can take responsibility for additional work on the same site. The following co-ordination arrangements are to apply as a minimum:
- a. The duty AP is to identify the extent of the work the second AP is to cover
  - b. The second AP is to be familiar with the extent of the works already being managed by The duty AP
  - c. The second AP is to sign on in the PIOR making a clear note that there are now two APs on duty and clearly state the extent of the work for which he is taking responsibility; this entry is to be countersigned by the duty AP.
  - d. Once the requirement for a second AP is complete, the appropriate AP is to sign off in the PIOR, making a clear note of the name of the remaining AP and informing that AP accordingly.

#### **4.8 Petroleum Safety Rule Book**

- 4.8.1 The Petroleum Safety Rule Book has been prepared for the benefit of all persons involved in working on Petroleum Installations for which the Ministry of Defence is responsible.
- 4.8.2 All persons who are issued with the Petroleum Safety Rule Book are to have it available for reference whenever they are working on Petroleum Installations.
- 4.8.3 The AP is to ensure that all appointed SkP are in possession of a Petroleum Safety Rule Book.

## **5. Operational Procedures**

### **5.1 General**

5.1.1 This Section describes the documents to be used and the operational procedures to be adopted when controlling work on any Petroleum Installation defined in these Safety Rules and Procedures.

### **5.2 Risk Assessment**

5.2.1 Risk Assessment is covered in JSP 375 Volume 3 Chapter 2.

5.2.2 For the purposes of these Safety Rules and Procedures there are two distinct types of risk assessment: an AP Risk Assessment and a Task Risk Assessment.

5.2.3 The AP Risk Assessment is required to be produced by the AP to address the hazards exhibited by the installation/system in relation to the task. It is to include information concerning the methodology for isolation and/or control of the task.

5.2.4 The Task Risk Assessment is required to cover the risks encountered in carrying out the task. The Task Risk Assessment is to be completed by the Contracting Organisation carrying out the task and also the person/persons carrying out the task. This is to include local hazard information supplied to the individual by the Area Custodian as detailed by JSP 375 Volume 2 Leaflet 34.

5.2.5 The Task Risk Assessment is to be submitted to the AP prior to the requirement for a Permit to Work or Standing Instruction, within a reasonable timeframe to allow the AP time for review.

5.2.6 The AP is to review the Task Risk Assessment and determine if it is consistent with the method of control. Should the AP consider the Task Risk Assessment inadequate, a Permit to Work or Standing Instruction is not to be issued. If the AP is in doubt as to the suitability of the Task Risk Assessment they are to refer to the AE for further guidance.

5.2.7 During the task the AP Risk Assessment is to be retained with the Safety Programme, and the Task Risk Assessment is to be retained with the associated Permit to Work or Standing Instruction.

5.2.8 Contents of all Risk Assessments must be communicated to all parties involved in the task.

5.2.9 A model form to record the findings of the AP Risk Assessment is given in Part 2. This does not restrict the use of other model forms that are used to record risk assessments for the purpose of complying with the Management of Health and Safety at Work Regulations.

### **5.3 Method Statement**

5.3.1 The Method Statement is a written procedure to be produced by those undertaking the work that specifies the works to be done. A Method Statement for the task is to be completed and submitted to the AP at the start of the planning process to enable an AP Risk Assessment to be developed. All activities that necessitate the issue of a Permit to Work or Standing Instruction are to be supported with an appropriate Method Statement which is to include the following as a minimum:

- a. A description of the task and location
- b. The sequence and method of work
- c. The hazards identified during the risk assessment

- d. The skills required to deal with the hazards
- e. The precautions necessary to control the hazards
- f. References to specific safety procedures covering known hazards
- g. Details of tools and equipment to be used
- h. Method of disposal of waste and debris
- i. Details of the state or condition in which the plant or equipment will be left at the end of the activity
- j. Emergency and Rescue Plan for confined space entry


## **5.4 Determining the Level of Control**

### **5.4.1 Decision Tree**

The decision tree provides guidance on the minimum level of control to be applied for common elements of tasks likely to be found on Petroleum Installations on the MOD estate. The AE should be consulted for advice where tasks fall outside of this guidance.



**Petroleum Main Decision Tree**

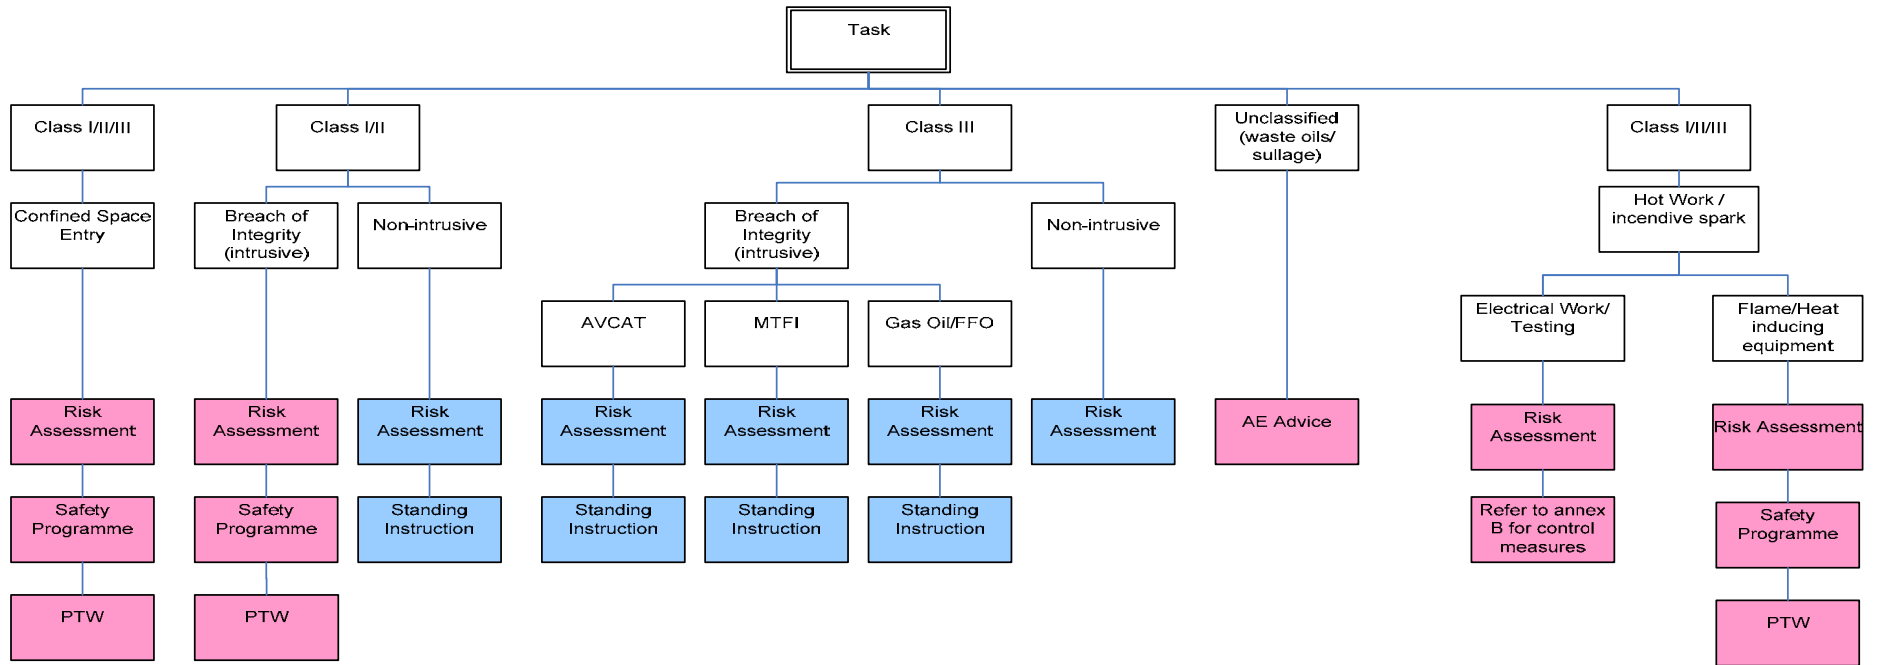

**Definitions:**  
**Breach of integrity** involves the exposure of product in liquid or vapour form.  
**Non-intrusive works** are those where no breach of integrity takes place for example Inspections, painting etc  
**Risk Assessment** – Refers to both AP and Task Risk Assessments are required  
**Note:** see Annex E for specific guidance on requirements for Grass cutting

High Risk

Low Risk

Updated 25/9/14

- 5.4.2 The level of control exercised, as determined from the required risk assessments over work on Petroleum Installations, will take the form of one of the following:
- a. Standing Instruction
  - b. Permit to Work
- 5.4.3 If work is planned simultaneously at multiple Petroleum Installations, a separate Permit to Work must be raised for work at each installation.
- 5.4.4 Normal practice should be to limit the number of Permit to Work issued for a hazardous area to one at any point in time. There may be occasions where multiple work activities in one hazardous area cannot be avoided requiring more than one Permit to Work, on such occasions the agreement of the AE to proceed must be sought. Work activities, their co-ordination and control shall be identified in the planning process, the AP Risk Assessment and detailed clearly within the PIOR.
- 5.4.5 Guidance on the requirements of the Standing Instruction and Permit to Work is given in Sections 5.7 and 5.9.

## **5.5 Restricted Area**

- 5.5.1 This is an area in which there is an increased risk of fire, explosion, asphyxiation or poisoning, due to spillage, defects or the nature of the work to be undertaken. Before a restricted area can be set up all operations must cease and all personnel withdrawn. A restricted area is to be set up when petroleum products are exposed in liquid or vapour form, when there is a requirement to enter confined spaces, there is a need for hot work to be undertaken or as a result of the AP Risk Assessment. Further guidance is detailed in Annex F.
- 5.5.2 When an area is restricted by the implementation of a Permit to Work, only one Permit to Work may be in use at any one time in that particular Restricted Area. Deviations from this are to be approved by the AE.

## **5.6 Safety Programme**

- 5.6.1 A Safety Programme (SP) is to be implemented before the issue of any Permit to Work, unless specified elsewhere within this Chapter.
- 5.6.2 The SP cannot be closed until all Permits to Work raised against it are complete and the integrity of the system/installation has been verified by the AP. This may be through visual inspection and/or successful integrity testing.
- 5.6.3 A SP is to have a format similar to the model form detailed in Part 2 of these Safety Rules and Procedures. Each sheet of the SP is to bear the same pre-printed serial number on the original and duplicate copies.
- 5.6.4 The SP is to include the necessary steps for control of the complete task. This is to include the issue of Permits to Work and general steps to completion of the work and reinstatement.
- 5.6.5 The SP is to include:
- a. The location of the installation
  - b. AP Risk Assessment number
  - c. The type of installation, which the proposed work sequence will make safe to work on
  - d. Cross-reference to other relevant certificates and permits
  - e. OA authorisation and contact details
  - f. The maximum gas concentrations applicable to the type of work to be undertaken

- g. Permissible oxygen level minimum of 19% and a maximum of 22% at the point of work
- h. Whether RPE and/or PPE and other safety equipment are to be used
- i. The point(s) of work, which is/are to be made safe
- j. Arrangements to isolate product and/or electricity supplies
- k. The name and signature of the originating AP (and where applicable the countersigning body)
- l. A schematic diagram with the points of the isolation, draining arrangements, points of Work, other safety measures and equipment
- m. The works sequence to be undertaken indicating:
  - i. The location at which each operation is to be performed
  - ii. The identity of each valve or component part to be operated
  - iii. The operation to be performed
  - iv. The reason for the operation
  - v. The maximum allowable gas concentration
  - vi. Any item (e.g. keys, locks, signs) required
  - vii. Any inspection/testing required to verify system integrity
  - viii. Steps required for reinstatement

5.6.6 The diagram required as part of the SP may either be a hand drawn or a CAD drawing (or section of one) or a copy of the relevant schematic stapled to the SP. Such drawings are to incorporate a title block, which includes the SP number, the name and signature of the AP, the name and signature of the PiC and is to be dated upon issue of the SP.

5.6.7 When the SP has been produced, including the work sequence, and is ready to be implemented, the AP is to obtain OA authorisation for the work to proceed by having them sign the SP at Part 2. The AP is then to issue the OA a copy of the SP for their reference.

5.6.8 The requirement for a second confirming signature (counter-signature) endorsing the safety programme, already signed by the originating AP, remains within the judgment of the AE and is not a mandatory prerequisite of these Safety Rules and Procedures.

5.6.9 Each isolation point is to be secured with a Safety Lock (where practical) and a Safety Sign fitted.

5.6.10 Upon completion of any initial isolations in the work sequence, the AP is to place any Safety Keys used into a Safety Key Box.

5.6.11 The AP is responsible for the safekeeping of the original of the Safety Programme throughout the works.

5.6.12 Once system/installation isolations have been made or removed the actions are to be recorded in the PIOR by reference to the item number of the sequence of operation entry contained within the SP.

5.6.13 When all work associated with a SP has been completed and all associated Permits to Work have been completed or stopped, the AP is to verify system integrity and cancel the original SP at Part 4. The installation is to then be returned to the OA who confirms return at Part 5. The original is then to be filed in the PIDR for a period of not less than three years.

## **5.7 Permit to Work**

5.7.1 A Permit to Work (PTW) is required as determined by the Decision Tree and AP Risk Assessment.

- 5.7.2 A PTW is to have a format similar to the model form detailed in Part 3 of these Safety Rules and Procedures. Each sheet of a permit is to be identified by the same pre-printed serial number on the original and copy. Sets of consecutively numbered forms are to be used.
- 5.7.3 Before the issue of the PTW the AP and prospective PIC are to carry out joint gas monitoring with two gas detectors, the highest reading of the two being recorded on the PTW together with the lowest oxygen reading.
- 5.7.4 The AP is to issue the PTW immediately before work is to commence and it is to remain in force until the work is completed or the PTW has been reaffirmed a maximum of seven times.
- 5.7.5 Where work is to continue over a number of days and the PTW will require reaffirming, the PTW is to be suspended at the end of each working day. The AP and PIC are to confirm that the work has been suspended, carry out gas monitoring and record in part 5 to confirm a safe condition prior to leaving site.
- 5.7.6 Whilst a PTW is in force a sign is to be displayed at the point of work clearly identifying that a PTW is in force and giving contact details of the AP and the Safety Programme number (this may form part of the Temporary Restricted Area Signage).
- 5.7.7 A PTW is to state precisely and legibly:
- The installation to be worked on
  - The location of the installation
  - The proposed work
  - The serial number of the Safety Programme
  - Where applicable, the serial number of any related safety documentation (i.e. Electrical PTW)
  - Validity period


## **5.8 Issue, Acceptance, Suspension and Cancellation of Permits to Work**


- 5.8.1 A PTW to be issued only at the point of work. The issue, suspension, re-affirmation and cancellation of every PTW are to be recorded in the PIOR.
- 5.8.2 The AP is to issue the PTW only to a SkP on the AP's Register of SkPs
- 5.8.3 Before the issue of a PTW the AP is to demonstrate to the SkP:
- The identity of the petroleum installation and the component parts to be worked on
  - Any initial isolations in accordance with the SP
  - The safety arrangements at the place of work and at points of isolation
  - Any special instructions and/or safety measures
- 5.8.4 Before the issue of a PTW the AP is also to ensure that the SkP is in possession of and understands the Task Risk Assessment and the Method Statement for the task.
- 5.8.5 Before accepting the PTW the prospective PiC is to:
- Read the PTW and the Safety Programme and sign the drawing(s)
  - Agree the extent of the work
  - Agree the safety precautions
  - Be prepared to supervise or undertake the work
- 5.8.6 The SkP is to sign the relevant section of the PTW to accept the responsibilities of the PiC. On signing for acceptance of the PTW the SkP authenticates the permit as valid and

becomes the PiC of the permitted work. The PiC is then to take control of the PiC Key from the Safety Key Box.

- 5.8.7 The acceptance of a PTW identifies the PiC as personally responsible for supervising or undertaking the defined work.
- 5.8.8 While the work is in progress, the PiC is not permitted to leave the site or to undertake any other work or tests. If for any reason the PiC has to leave the point of work then during that temporary absence work is to be halted. The PiC is to ensure that suitable safety precautions are taken and the AP informed, before leaving the point of work.
- 5.8.9 Where a change of AP and/or PiC is required, the incoming AP/PiC are to carry out the joint checks and are to sign part 5 of the PTW to accept control of the work and any restrictions and controls laid down in the safety paperwork. The change is to be recorded in the PIOR.
- 5.8.10 On completion of the work the PiC is to:
- Inspect the work to ensure that it is complete and that system integrity has been restored.
  - Withdraw all persons, equipment, tools and instruments from the point of work
  - Advise all persons under their control that they are no longer permitted to work on the petroleum installation
  - Complete and sign the relevant section of the original PTW
  - Return the original PTW and PiC Key to the Safety Key Box to the AP
- 5.8.11 The AP is to confirm that the work has been completed satisfactorily by a visual check whilst also carrying out final gas monitoring with the PiC and record in part 3 of the PTW, to confirm safe condition prior to cancelling the PTW.
- 5.8.12 The AP is to cancel the PTW by signing part 8 of the original and filing in the PIDR and recording the cancellation in the PIOR.
- 5.8.13 If the AP decides that it is necessary to stop the work, the PTW is to be withdrawn and cancelled. The withdrawal is to be noted on part 7 and 8 of the copy of the PTW and the reasons for withdrawal recorded in part 6 and any actions taken are to be noted in the PIOR. A new PTW is required before re-starting work.
- 5.8.14 The PTW is to be cancelled or suspended if during the period of validity, any of the following conditions apply (including but not limited to):
- At the end of the working day
  - The conditions under which it was issued change beyond the stipulated limits e.g. gas concentration and oxygen percentages
  - A change of work is necessary which is not authorised on the original PTW
  - Any personnel or contractors disregard the conditions of the PTW/or the MOD Safety Rules and Procedures
  - There is a failure of safety equipment
  - Prolonged absences of the AP or PiC
  - The OA requests the discontinuation of the work
  - Should any accident or incident occur. For example, injury to personnel, damage to equipment or plant or spillage of product
  - Electrical storm
- 5.8.15 Where the work is stopped and the PiC has returned the PTW, the AP is to annotate the original Safety Programme to highlight that work may not be complete. This serves to prevent removal of the isolations until all associated work is complete and the integrity of the system has been restored.

- 5.8.16 If the PiC has lost the original PTW, the loss is to be recorded by the AP in the PIOR. The copy of the PTW is then to be used in place of the original and cancelled in accordance with the above paragraphs. The PiC is to countersign the statements in the PIOR to confirm and acknowledge the loss of the PTW.
- 5.8.17 All original PTWs, together with their associated Risk Assessments and Safety Programme are to be retained in the PIDR for a minimum period of three years after the cancellation date.

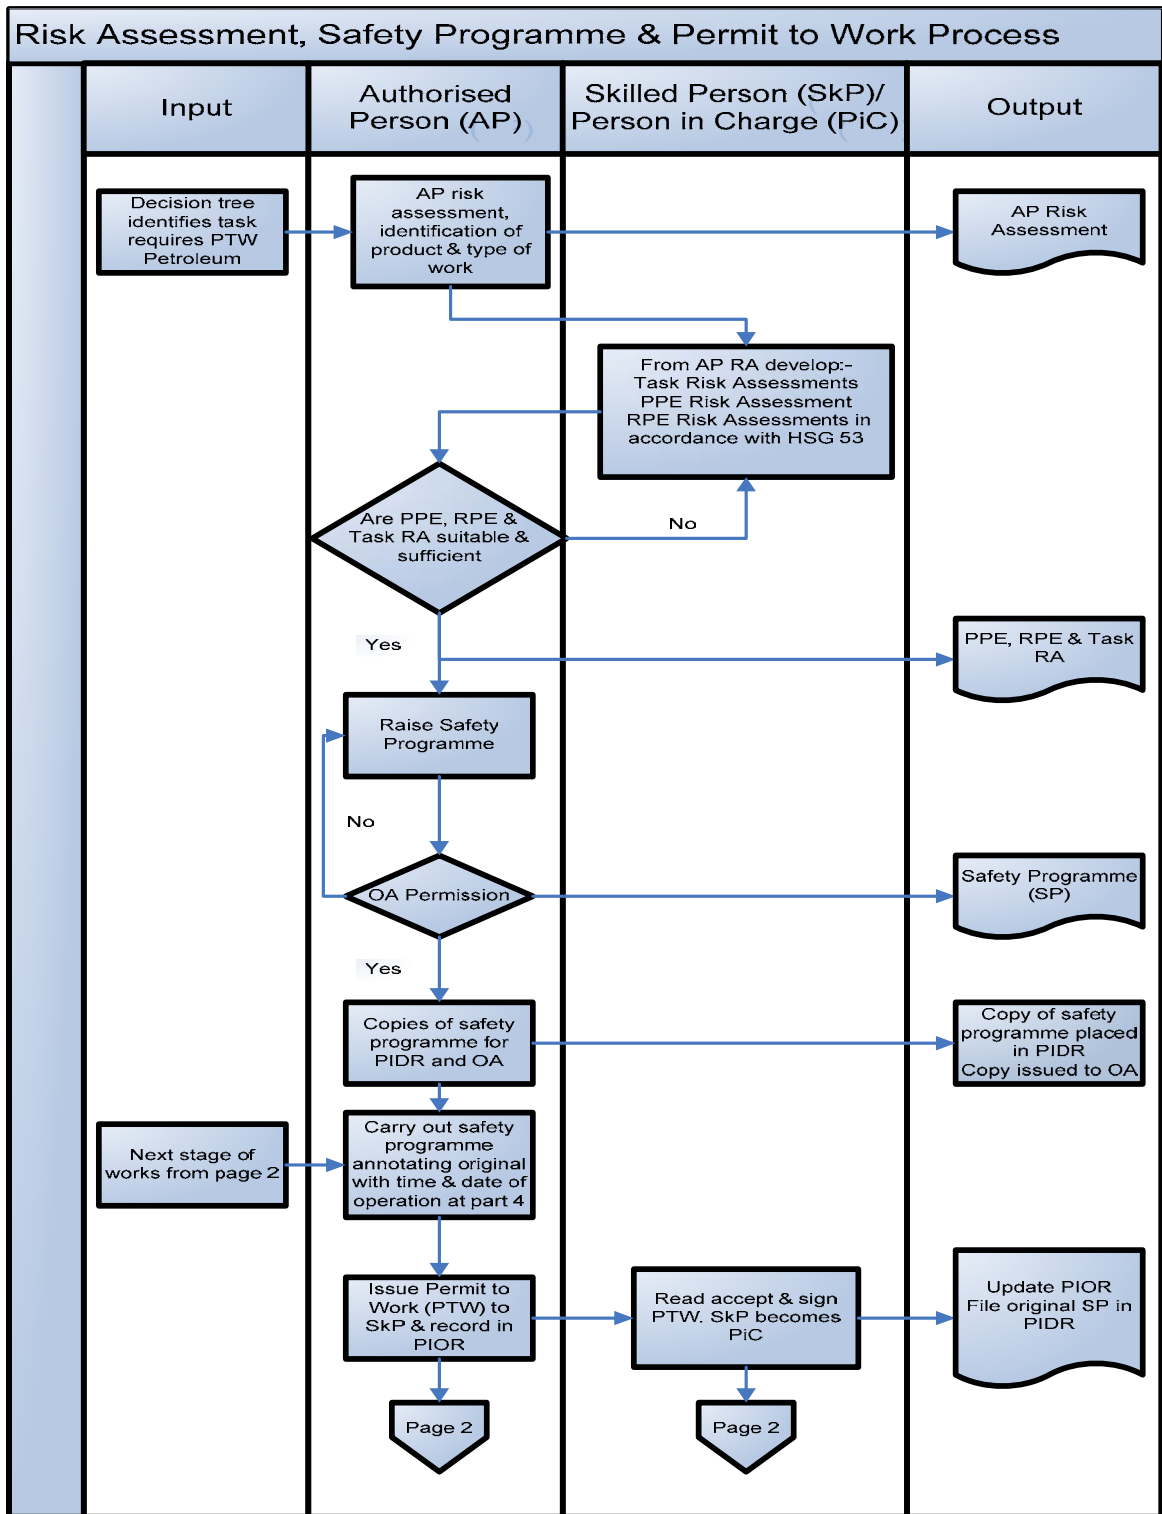

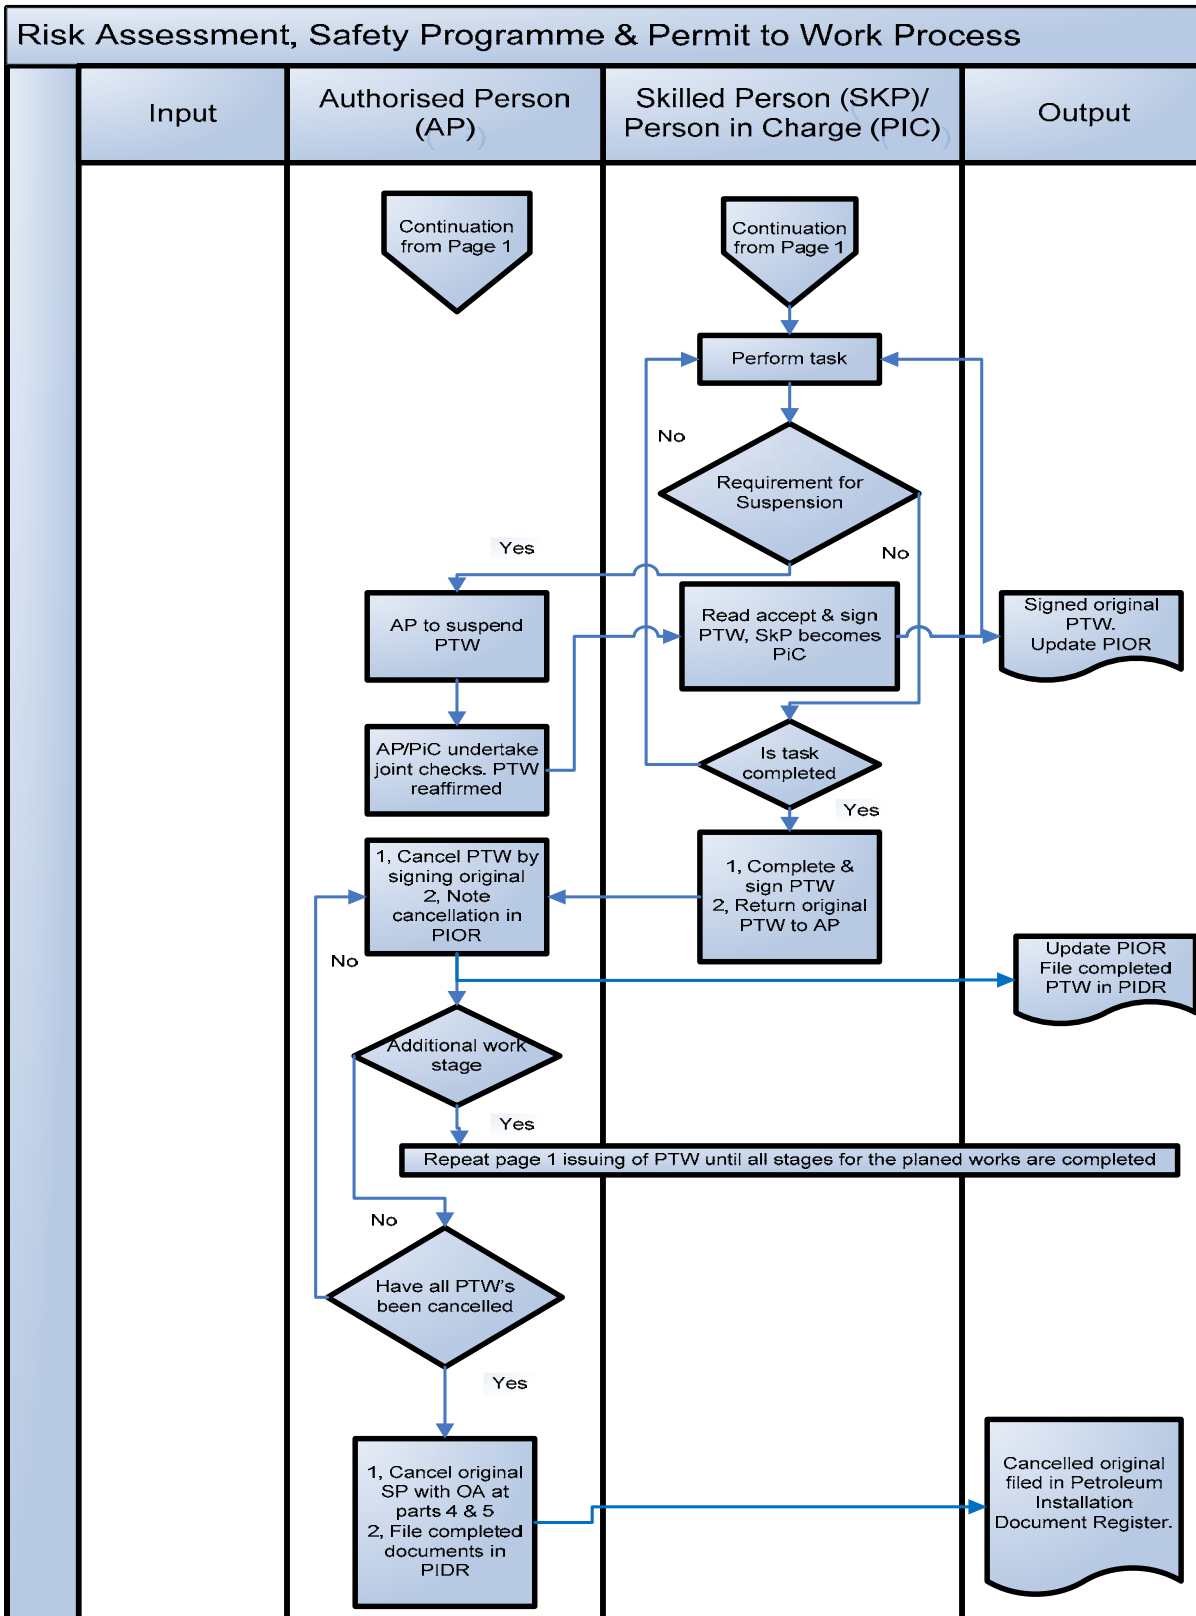

## 5.9 Standing Instruction


- 5.9.1 A Standing Instruction (SI) can be issued by the AP to a SkP for both one-off and repetitive tasks on Petroleum Installations where the AP risk assessment has determined that the task is low risk and a Permit to Work is not appropriate.
- 5.9.2 An SI is required as determined by the Decision Tree and the AP Risk Assessment.
- 5.9.3 Non intrusive work on Class I and II installations may be defined as low risk maintenance tasks, not including any task which exposes petroleum products in liquid, gas or vapour form, introduction of a source of ignition, or involves confined space entry. Examples of these non intrusive tasks are:
- a. External painting
  - b. Adjusting machinery, equipment and metering
  - c. Adjustment and tightening of valve glands (excluding repacking)
  - d. Maintenance tasks of valve gear equipment
  - e. Minor adjustment or replacement of instruments and equipment
- 5.9.4 Intrusive works on Class III installations may be defined as low risk maintenance tasks. Electrical work and testing on all Class III installations may be defined as a low risk task.
- 5.9.5 An SI is to contain the following information:
- a. Validity period of SI
  - b. Location and Identity of equipment
  - c. Task or operation to be undertaken
  - d. Detail of tasks to be carried out
  - e. Special instructions or safety measures applicable
  - f. Originating AP
  - g. Name of SkP
  - h. Employer
- 5.9.6 SIs must be specific to a system and must contain sufficient detail with respect to the procedure required to be undertaken by the SkP to ensure that the facilities and installations are safe before commencement of work. The Process Chart details the procedure for issuing a SI, and is found at the end of this section.
- 5.9.7 All risks and hazards associated with the work to be carried out under a SI and the controls identified to manage them must be fully communicated to the PiC prior to commencement and issuing of a SI. All work on Petroleum Installations will be co-ordinated by the AP to ensure that the petroleum related risks are fully taken into account. For all petroleum tasks undertaken by a SI, a Task Risk Assessment and Method Statement will be produced by the PiC and reviewed by the AP.



- 5.9.8 SIs Electrical issued by the AP Electrical for electrical work are outside the scope of these Safety Rules and Procedures and are covered in JSP 375 Volume 3 Chapter 3.
- 5.9.9 A SI is to have a format similar to the model form SRP PET 05 of these Safety Rules and Procedures. Each sheet of a SI is to be identified by the same unique serial number on the original and duplicate copies.

## **5.10 Issue, Acceptance and Cancellation of Standing Instructions**

- 5.10.1 Having determined the level of control from the AP Risk Assessment and the Decision Tree, the AP may raise a SI for the defined or repetitive task(s). The AP must detail:
- The task or operation to be conducted on the equipment
  - Specified circumstances under which the task may be conducted
  - Any special instructions or safety measures
- 5.10.2 The AP authorises the SI by signing Part 1 of the document.
- 5.10.3 The AP then informs the OA of the proposed issue of the SI, detailing the task to be undertaken, advising of the effect that the task may have on operations (such as loss of any service). The OA will acknowledge the issue of the SI by signing Part 2.
- 5.10.4 Having acknowledged the instruction(s) and being prepared to undertake the task(s), the SkP is to sign and accept the SI by signing Part 3. On signing for acceptance of the instruction a SkP authenticates the instruction and becomes the PiC of the permitted task(s). Notwithstanding that the PiC has been authorised to undertake the task, he must comply with the notification regime and instructions on the SI before conducting the task on each occasion.
- 5.10.5 The issue of an SI is to be recorded in the PIOR. The original copy of the SI is to be issued to the SkP who then becomes the PiC. A duplicate copy is to be retained in the PIDR.
- 5.10.6 When an AP is appointed or returns to duty the AP is to review the PIOR to check for any SI in force.
- 5.10.7 On completion of the tasks outlined in the SI or on reaching the expiry date, the PiC is to return the instruction to the AP for cancellation. The AP is to cancel the SI by destroying the duplicate copy and completing the cancellation section at Part 4 of the original document.
- 5.10.8 Alternatively the AP may cancel an SI at any time by retrieving the original from the PiC and destroying the duplicate and completing the cancellation section at Part 4 of the original document.
- 5.10.9 The cancellation of a SI is to be noted in the PIOR.
- 5.10.10 If the PiC has lost the original SI, the loss is to be recorded by the AP in the PIOR. The copy of the SI is then to be used in place of the original and cancelled in accordance with the above paragraphs. The PiC is to countersign the statements in the PIOR to confirm and acknowledge the loss of the SI.
- 5.10.11 An SI is not to be transferred from one PiC to another.
- 5.10.12 A SI is to be valid for not more than three years and must be reviewed by an AP at intervals of not more than twelve months or following any change or modification to the system; the review of the SI is to be recorded in the PIOR.

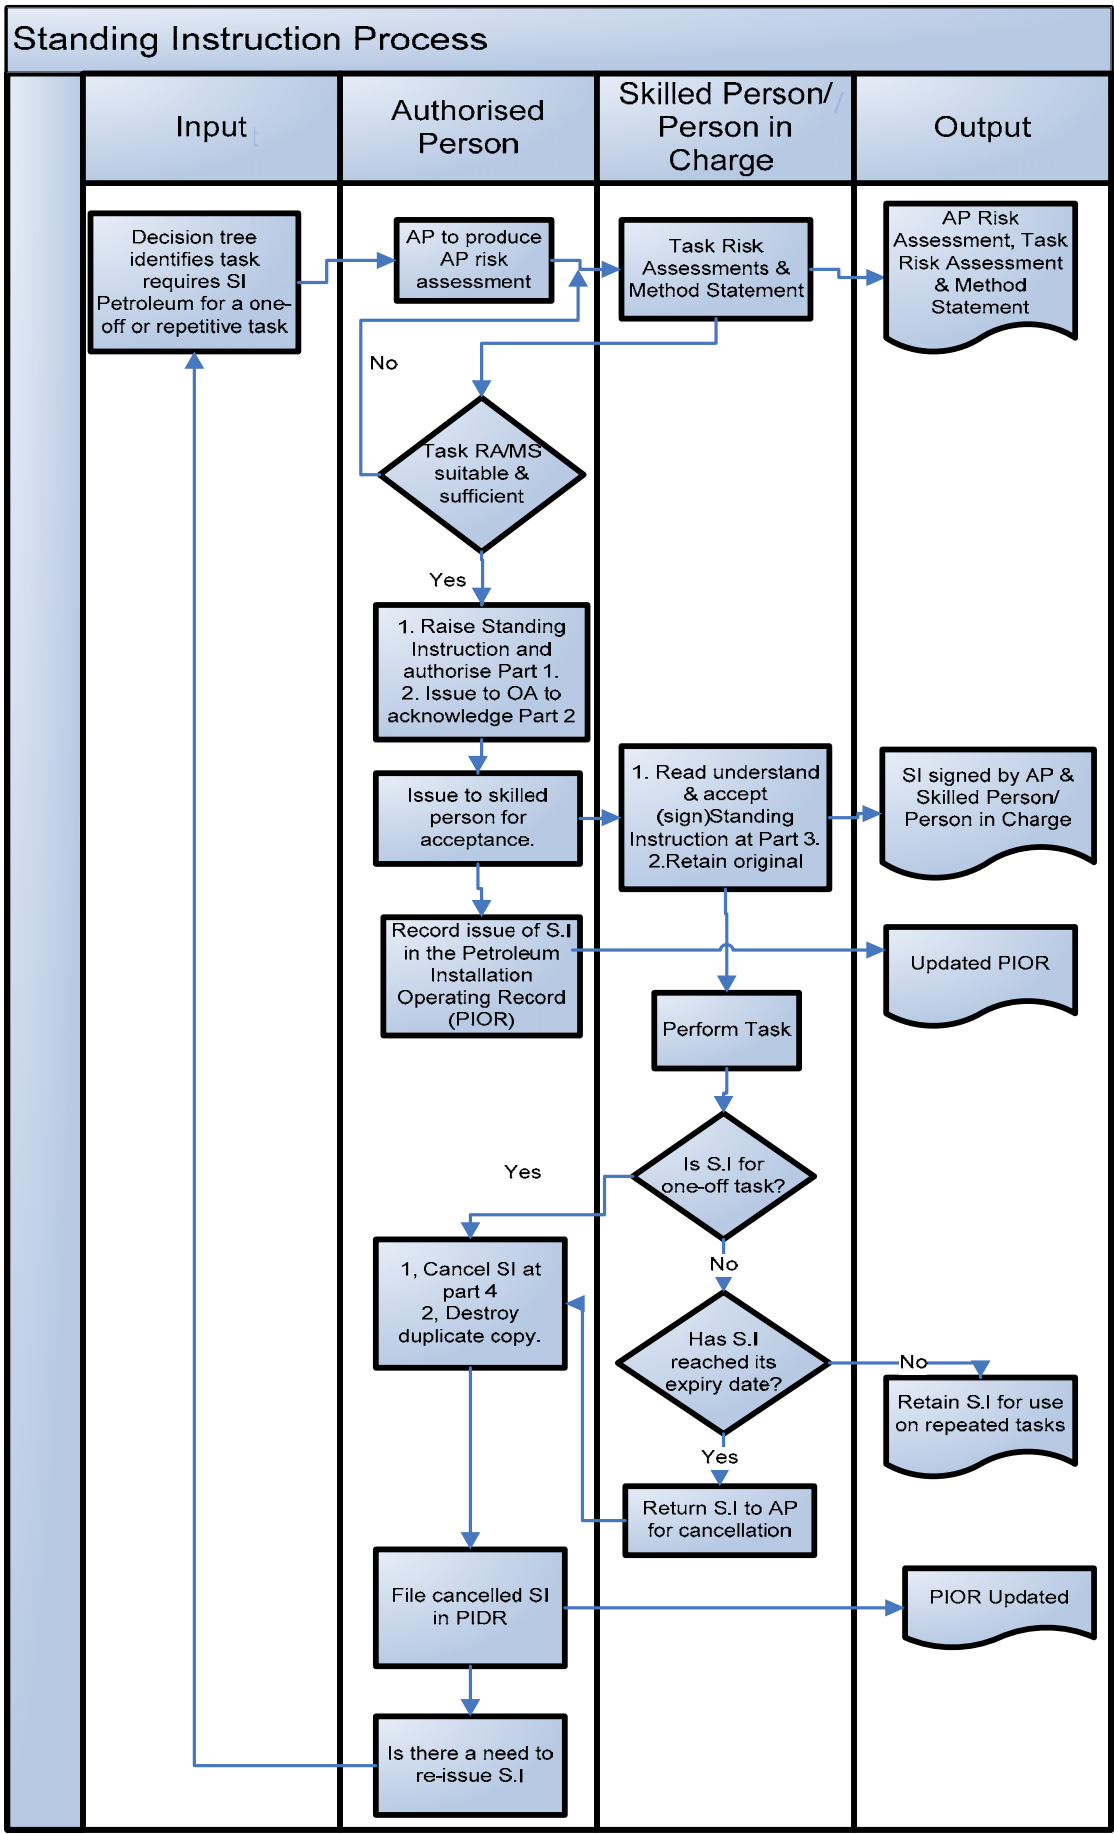

## **6. Training**

### **6.1 Introduction**

- 6.1.1 This Section deals with the technical training requirements for those involved in the conduct or management of work on Petroleum Installations.
- 6.1.2 The requirements for general training for APs and AEs are given in JSP 375 Volume 3 Chapter 2 and are not discussed further within this section.
- 6.1.3 It is a pre-requisite for both the AP and AE candidates to have undertaken on-site familiarisation training and to be in possession of an up-to-date personal Logbook prior to attending the training stipulated below. In addition they should be familiar with
- a. The concept of Risk Assessments, Safety Programmes and other safety documentation
  - b. Behavioural interviewing techniques
  - c. The safety documents held on the establishments for which they are to be appointed

### **6.2 Authorising Engineer**

- 6.2.1 AEs for the petroleum discipline must achieve the same technical training standards as given in Section 6.3 for an AP.
- 6.2.2 The AE for a site is to be involved in the selection and training requirements of APs intended for appointment on that site.

### **6.3 Authorised Person**

- 6.3.1 The AP training aims to ensure that, on completion, participants can demonstrate a thorough and practical understanding of the safe systems of work and associated procedures contained within this Chapter of JSP 375 Volume 3.

### **6.4 Training Content**

- 6.4.1 Training will cover
- a. An introduction to petroleum products, their characteristics and classifications
  - b. An overview of associated statutory regulations
  - c. An overview of petroleum systems and the types of fuel installations on the MOD Estate
  - d. An introduction to MOD Petroleum Safety Rules and Procedures
  - e. The scope of the Petroleum Safety Rules and Procedures
  - f. An overview of operational appointments
  - g. The specific roles and responsibilities of appointed personnel with respect to Petroleum the Petroleum Safety Rules and Procedures
  - h. Hazards and risks associated with petroleum products (fire, explosion, asphyxiation, poisoning, environmental) and petroleum infrastructure (confined spaces, working at height, electricity).
  - i. Isolation methodology
  - j. Personal and respiratory protective equipment
  - k. Test and safety equipment
  - l. Electrical work in petroleum areas
  - m. Management, application and control of Petroleum Safety Rules and Procedures Documentation
  - n. Implementation of the Safety Rules and Procedures on site and to tasks

- o. Associated MOD and commercial documents
- p. Any additional specialist training identified by the AE, such as confined space awareness

### **Learning outcomes**

6.4.2 On completion of the course, candidates shall be able to:

- a. List and differentiate petroleum products
- b. Demonstrate an understanding of the classification of fuels
- c. Identify installations and equipment within the scope of JSP 375, Volume 3, Chapter 5
- d. List the roles and responsibilities of those parties with operational appointments relating to JSP 375, Volume 3, Chapter 5
- e. Identify hazards, risks and control measures associated with working with petroleum products and installations
- f. Identify the different test and safety equipment available; understand their use and limitations and inspection requirements
- g. Demonstrate knowledge of the AP Petroleum requirements for electrical work in petroleum areas
- h. Demonstrate a knowledge of the management, application and control of Petroleum Safety Rules and Procedures documentation
- i. Demonstrate an understanding of the planning required prior to start of works including AP Risk Assessments and Safety Programme and how they should be applied
- j. Produce suitable and sufficient AP Risk Assessments for typical tasks on Petroleum Installations
- k. Prepare Safety Programmes, Permits to Work and Standing Instructions in accordance with these Safety Rules and Procedures
- l. State the action to take when there are conflicting requirements listed in statutory regulations, these Safety Rules and Procedures and any local rules
- m. Demonstrate an understanding of the requirement for demarcation agreements

### **Assessment**

6.4.3 In the case of refresher training, this shall be suitable and sufficient for the relevant AE/AP.

## Acknowledgements

These revised Safety Rules and Procedures have been produced by a joint Industry / Ministry of Defence Working Group comprising representation from the following contributing companies, organisations and individuals:

Interserve Defence Ltd  
Sodexo  
Debut  
Babcock International  
Turner Facilities Management  
Carillion  
Defence Infrastructure Organisation  
Develop Training

# **PART 2**

# **SUPPORTING GUIDANCE**

### Isolation Methodology

- A. 1** The isolation methodology used on the MOD Estate is to be based on the risk exhibited by the system and in the Health and Safety Executive publication 'The Safe Isolation of Plant and Equipment' HSG 253. This is the lead reference when determining isolation and control.
- A. 2** All isolation methods can fail. The potential for human failure is a major factor affecting the reliability of an isolation method. The performance of an isolation depends not only on the integrity of the isolation hardware, but also on the adequacy of the arrangements to identify each isolation point, secure the isolation, prove/monitor the isolation and maintain total control of the work. When selecting an isolation method, consideration should be given for the potential of both mechanical and human failure.
- A. 3** Security during the intrusive task is provided by the final isolation. An initial isolation may also be required to enable this final isolation to be installed. A range of isolation techniques are detailed in A10. The choice of final isolation method should be based on risk assessment. In the instance where an isolation of higher integrity is available, and where it is reasonably practicable to use, it should be used, except where this would not reduce risk.

#### Stages of Isolations

- A. 4** Installation of isolations can, involve two stages
  - a. An initial isolation
  - b. A final or full isolation.
- A. 5** The initial isolation, which is usually a valve, enables draining and the insertion of downstream positive isolation once depressurised and drained. Positive isolation can take the form of a blank, spade or spectacle plate and can be accompanied by the removal of pipework sections. The safety of this initial isolation must be considered when selecting your final isolation method. A key requirement during the initial isolation is to identify whether valves being used provide an acceptable level of isolation. Physical disconnection should be used wherever reasonably practicable.
- A. 6** The final isolation protects those carrying out the work, and those who might otherwise be affected from a release of fuel or vapour from the system. For tasks involving confined space entry or where isolations are to be in place for an extended period of time positive isolations must be used where practicable.
- A. 7** When using valves for pipeline isolation, you should aim to achieve a double block and bleed isolation. Suitable blank flanges and / or plugs should be used to close off any open pipework. These should be appropriately rated and properly installed with the correct gaskets and securing bolts so that they can withstand the system pressure and product characteristics.
- A. 8** Localised isolation of pipelines can involve various techniques or combinations, e.g. valves, removable spool pieces, pipe freezing, line plugging, pipe stoppers, bags, high friction pigs or spheres, use of 'slugs' of inert fluids and flooding sections of pipeline with water.
- A. 9** Devices other than blanks, plugs or caps that are proposed to be used to seal the ends of open pipework to enable pressure testing or work activities will require a specialised assessment and approval by the AE. This includes specialised systems that provide local isolation as detailed in A8.

## A. 10 Isolation Techniques

### Positive isolation

Complete separation of the plant/equipment to be worked on from other parts of the system.

#### Example

- Physical disconnection (e.g. spool removal)

Valved isolation to an appropriate standard is required to enable positive isolation.

#### Example

- Double block, bleed (DBB) and spade
- Single block and bleed (SBB) and spade

### Proved isolation

The effectiveness of the valved isolation can be confirmed via vent/drain points before intrusive work commences. Within this isolation category the level of mechanical security is greatest for DBB and lowest for SBB.

#### Example

- Double block and bleed
- Double seals in a single valve body with a bleed in between
- Single block and bleed

SBB should not normally be used as a final isolation method; approval by the AE should be obtained where the use is considered justified and where the risk assessment has shown it to be acceptable.

### Non-proved isolation

The effectiveness of valved isolation can not be confirmed by vent/bleed points before intrusive work commences.

#### Example

- Double valve
- Single valve

**A. 11** Proposals to use non-proved isolation are to be agreed by the AE.

**A. 12** Further guidance is available in 'HSG 253 'The Safe Isolation of Plant and Equipment'.

**A. 13** It should be noted that if the point of work is in line then appropriate isolation is required either side of the point of work.

## **Electrical Isolation**

**A. 14** Electrical isolation for the purpose of petroleum maintenance may be made without reference to the AP (Electrical) when the isolation is via a switch or circuit breaker, and the switch or circuit breaker can be locked in the 'off' position by use of a safety lock. Where there is uncertainty of appropriate electrical circuit/system isolation the AP Electrical should be consulted.



- A.15** When the isolation requires the removal of fuses or the disconnection of cable terminations the isolation is to be made by an appointed Skilled Person (Electrical) or an Authorised Person (Electrical).

**Fuel Oil Isolation**

- A.16** Suitably competent personnel working for the MMO may isolate and carry out maintenance on a fuel oil supply pipework to an item of equipment provided that the fuel in question is Class II or III and that the work is within the confines of a boiler house, plant room or generator house.

# Electrical Works in Petroleum Hazardous Areas

## B.1 Introduction

This annex covers work on or the testing of electrical equipment and systems within the defined hazardous area, as identified in accordance with the Dangerous Substances and Explosive Atmosphere Regulations (DSEAR), zonal classification drawings and associated risk assessments for Petroleum Installations on the MOD estate, which should be read in conjunction with the main Safety Rules and Procedures.


## B.2 General

The management of Electrical work and testing in petroleum hazardous areas is to be under the overall control of the Authorised Person Petroleum.

This will require an AP Risk Assessment. A Petroleum Safety Programme will not normally be required for electrical works unless the AP Petroleum identifies a requirement for isolation.

The decision tree in 5.4.1 and this annex provides guidance on the level of control to be applied under these Safety Rules and Procedures and JSP 375 Volume 3 Chapter 3 Electricity. The AE Petroleum should be consulted for advice where works fall outside the scope of this guidance.

Electrical Works & Testing within Petroleum Installations

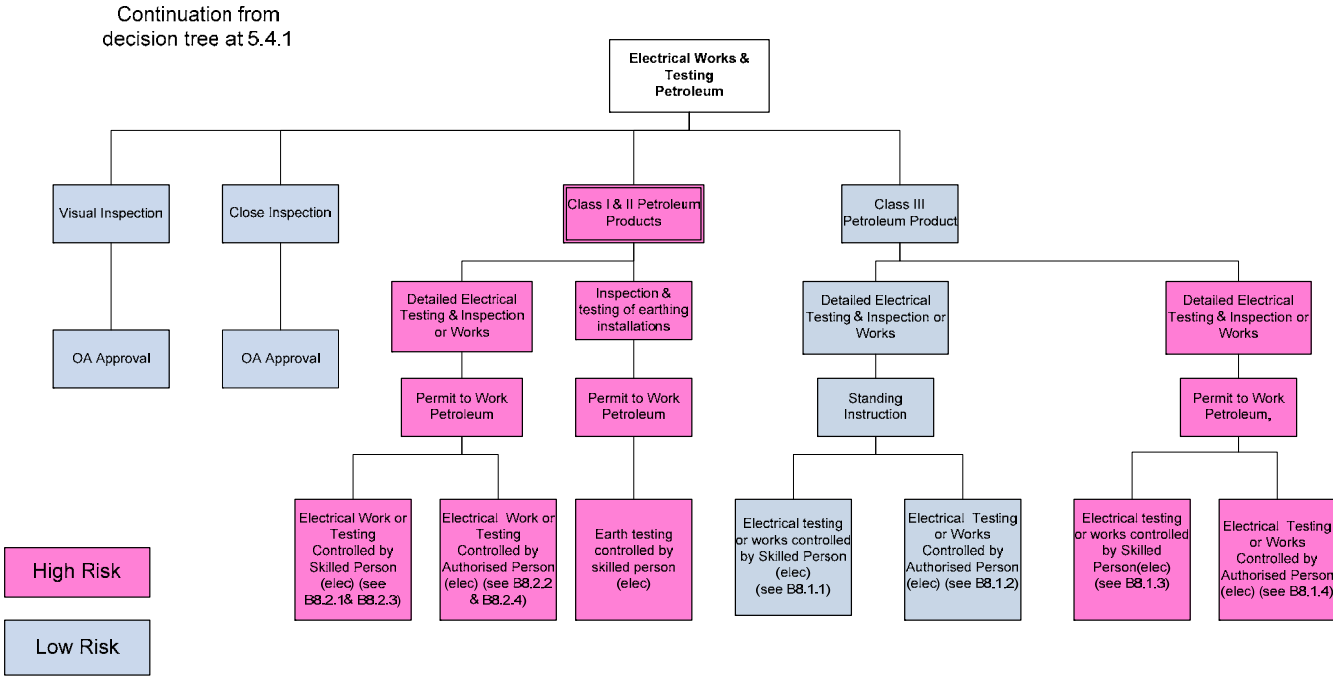

Notes

- 1, Permit to work & SI are petroleum documents in accordance with this chapter
- 2, This decision tree applies to all electrical installation within in facilities as defined within the scope of this chapter

### B.3 Aspects of Electrical Work and Testing on Petroleum Installations

There are six aspects of electrical work (incl. testing) on Petroleum Installations to be considered to enable the petroleum related risks to be controlled, by these Safe Systems of Work described in this guidance. These aspects are in addition to the general requirements for the control of the electrical danger.

1. The integrity of the concept of protection of electrical equipment subject to maintenance must be restored when the maintenance is complete, and the integrity must be appropriate for the DSEAR hazardous zone classification for any new equipment installed. No alteration that will invalidate the certificate or other approval document relating to the protection of the electrical equipment or system is to be made.
2. Equipment must not be opened, or the protection disturbed, until it is electrically isolated and a gas free condition established, where identified as a control measure within the TRA and in accordance with the gas monitoring regime as detailed in B8.2.1 and B8.2.2 or where there is a risk of vapour draft from class I or II petroleum installation prior to proving dead.
3. Electrical testing can cause induced currents and voltages throughout an installation, due to earth bonding and lightning protection systems. To reduce the risks from incendive sparks and where identified as a control measure on the TRA, electrical testing is to be carried out under the control of a gas monitoring regime as detailed in B8 2.1 and B8.2.2.
4. Electrical testing within the hazardous areas is defined within BS EN 60079 part 17 as one of the following:
  - a. Visual Inspection, inspection undertaken without the use of tools or access equipment
  - b. Close Inspection undertaken with the use of tools and access equipment and may include minor repairs. Example of what is considered as minor repairs are:
    - Tightening of external loose bolts and fixings
    - Painting of enclosures and equipment
    - Re-termination of external earth bonds
    - Tightening of external earth connection
    - Cleaning, removal of accumulation of dust & dirt
    - Replacement of external cable ID tags
    - Re-fixing of cables to cable trays & supports
  - c. Detailed Inspection, which requires the removal of covers to expose electrical connection and testing using test instruments

Visual and Close inspections are to be controlled by the AP's (PET) RA, the TRA and Method Statement.

Detailed inspections are to be controlled by the AP Petroleum's RA, TRA, Method Statement and PTW Petroleum in accordance with requirements of JSP 375 Volume 3 Chapter 3 and JSP 375 Volume 3 Chapter 5 Decision Tree within this annex.

5. Inspection and testing of earthing system and lightning protection (LPS) in accordance with BS 7430 & BS EN 62305 can cause stray voltages & currents during testing resulting in incendive sparks occurring.
6. The maintenance of electrical equipment in hazardous areas shall be carried out by SkP Electrical having adequate training, experience, and theoretical knowledge to be considered as a competent person on electrical equipment installed in hazardous atmospheres.

#### **B.4 Planning and Co-ordination**

The planning of electrical work and testing at Petroleum Installations requires the AP Petroleum, AP Electrical (Hazardous Areas) and OA to co-operate and co-ordinate when defining the task, and deciding on the appropriate work method and when completing an AP (PET & Elec) RA, with particular emphasis on:

1. The elimination of the risk of creating a source of ignition within the hazardous area Whilst undertaking the work or test.
2. identification of the potential for the following:
  - a. Product exposure
  - b. Product atomisation due to elevated pressures
  - c. Vapour drift
  - d. Elevated temperatures (either surface or ambient)
  - e. Creation of an incendive spark
  - f. Loss of safety critical electrical systems
3. Electrical isolations as appropriate (to include control systems).
4. Control of the Safe System for electrical work which is the responsibility of the Authorised Person Electrical (Hazardous Areas).

#### **B.5 Responsibilities of the Authorised Person Electrical**

The Authorised Person Electrical (Hazardous Areas) is responsible for:

- a. Compliance with the Safety Rules and Procedures Electrical.
- b. Ensuring there are suitably qualified and experienced Skilled Persons (Electrical) to work on or test electrical equipment in petroleum hazardous areas.
- c. Co-ordination with the Authorised Person Petroleum.
- d. Determining the requirement for Electrical Safety Documentation
- e. Ensuring that the TRA and Method Statement are available and have been reviewed

#### **B.6 Responsibilities of the Skilled Person**

The principle adopted is that of using SkPs appointed under the Electricity Safety Rules and Procedures to undertake the electrical task. SkPs are:

- a. To have sufficient training, knowledge, experience and understanding of the petroleum hazards.
- b. To confirm by their signature that they have completed the works/tests correctly and document in accordance with BS EN 60079 part 17. The electrical equipment has been restored to the correct level of concept of protection, and the installation is suitable to be returned to service.
- c. To carry out gas monitoring of the environment as required.

## **B.7 Responsibilities of the Authorised Person Petroleum**

The Authorised Person Petroleum is responsible for:

- a. Co-ordinating the electrical work or test with, and seeking the authorisation of, the OA
- b. Implementing any control measures required as a result of the AP Petroleum RA
- c. Assess suitably qualified and experienced Skilled Persons (Electrical) to become SkP (Petroleum) for working on or testing electrical equipment in petroleum hazardous areas.

## **B.8 Works Control**

### **B 8.1 Electrical Testing, Inspection or Works in a Class III installation**

#### **B 8.1.1 Standing Instruction (Petroleum) & JSP 375 Volume 3 Chapter 3 Table HAZ 3**

Electrical work/test are to be controlled by a Standing Instruction Petroleum and table HAZ 3 of JSP 375 Volume 3 Chapter 3 providing the following criteria are met:

- a. Those undertaking the task are to confirm with OA the cessation of product receipt, transfer and dispense and be satisfied that the residual risk would not result in the ignition of product.
- b. Table HAZ 3 of JSP 375 Volume 3 Chapter 3 is to be used where the clear and certain identity of the points of isolation of the equipment to be worked on is established.
- c. There is no foreseeable risk of ignition through:

exposure of product, atomisation of product, vapour drift (from a higher classification product);

or

elevated temperatures (either surface or ambient), and a source of an incendive spark

#### **B 8.1.2 Standing Instruction (Petroleum) & JSP 375 Volume 3 Chapter 3 Table HAZ 1 & 2**

Where it cannot be established that there is clear and certain identity of the point of isolation for the equipment to be worked on or tested and where as a result of the AP Petroleum's review there is no foreseeable risk of ignition the method of control is:

- a. Authorised Person Petroleum to issue a Standing Instruction
- b. Those undertaking the task are to confirm with OA the cessation of product receipt, transfer and dispense and be satisfied that the residual risk would not result in the ignition of product
- c. Authorised Person Electrical (Hazardous Areas) is to control in accordance with electrical Safety Rules and Procedures tables HAZ 1 & HAZ 2 of JSP 375 Volume 3 Chapter 3

### **B 8.1.3 Permit to Work (Petroleum) & JSP 375 Volume 3 Chapter 3 Table HAZ 3**

Where there is clear and certain identity of the point of isolation for the equipment to be worked on and or tested is established and where as a result of the AP Petroleum's review there is a foreseeable risk of ignition the method of control is:

- a. Authorised Person Petroleum is to issue a PTW Petroleum and carry out the initial gas monitoring checks in accordance with Annex C. The PiC will be responsible for the continuous gas monitoring and the recording in accordance with Annex C.
- b. Skilled Person Electrical is to control in accordance with electrical Safety Rules and Procedures table HAZ 3.

### **B 8.1.4 Permit to Work (Petroleum) & JSP 375 Volume 3 Chapter 3 Table HAZ 1 & 2**

Where it cannot be established that there is clear and certain identity of the point of isolation for the equipment to be worked on and or tested cannot be established and where as a result of the AP Petroleum's review there is a foreseeable risk of ignition the method of control is:

- a. Authorised Person Petroleum is to issue a PTW Petroleum and carry out the initial gas monitoring checks in accordance with Annex C. The PiC Electrical will be responsible for the continuous gas monitoring and the recording in accordance with Annex C.
- b. Authorised Person Electrical (Hazardous Areas) is to control in accordance with electrical Safety Rules and Procedures tables HAZ 1 & HAZ 2 of JSP 375 Volume 3 Chapter 3.

## **B8.2 Electrical Works in a Class I & II installation**

### **B 8.2.1 Permit to Work (Petroleum) & JSP 375 Volume 3 Chapter 3 Table HAZ 3**

Where clear and certain identity of the point of isolation for the equipment to be worked on and or tested is established and where as a result of the AP Petroleum's review there is no foreseeable risk of ignition the control method is:

AP Petroleum is to issue a PTW Petroleum and carry out the initial gas monitoring checks in accordance with Annex C. The PiC will be responsible for the continuous gas monitoring and the recording in accordance with Annex C.

Skilled Person Electrical is to control in accordance with electrical Safety Rules and Procedures table HAZ 3 of JSP 375 Volume 3 Chapter 3.

### **B 8.2.2 Permit to Work (Petroleum) & JSP 375 Volume 3 Chapter 3 Table HAZ 1 & 2**

Where clear and certain identity of the point of isolation for the equipment to be worked on and or tested cannot be established and where as a result of the AP Petroleum's review there is no foreseeable risk of ignition the method of control is:

Authorised Person Petroleum is to issue a PTW Petroleum and carry out the initial gas monitoring checks in accordance with Annex C. The PiC will be responsible for the continuous gas monitoring and the recording in accordance with Annex C.

Authorised Person Electrical (Hazardous Areas) is to control in accordance with electrical Safety Rules and Procedures tables HAZ 1 & HAZ 2 of JSP 375 Volume 3 Chapter 3.

### **B 8.2.3 Permit to Work (Petroleum) & JSP 375 Volume 3 Chapter 3 Table HAZ 3**

Where clear and certain identity of the point of isolation for the equipment to be worked on and or tested is established and where as a result of the AP Petroleum's review there is no foreseeable risk of ignition the control method is:

AP Petroleum is to issue a PTW Petroleum and carry out the initial gas monitoring checks in accordance with Annex C. The PiC will be responsible for the continuous gas monitoring and the recording in accordance with Annex C.

Skilled Person Electrical is to control in accordance with electrical Safety Rules and Procedures table HAZ 3 of JSP 375 Volume 3 Chapter 3.

### **B 8.2.4 Permit to Work (Petroleum) & JSP 375 Volume 3 Chapter 3 Table HAZ 1 & 2**

Where clear and certain identity of the point of isolation for the equipment to be worked on and or tested cannot be established and where as a result of the AP Petroleum's review there is a foreseeable risk of ignition the method of control is:

Authorised Person Petroleum is to issue a PTW Petroleum and carry out the initial gas monitoring checks in accordance with Annex C. The PiC will be responsible for the continuous gas monitoring and the recording in accordance with Annex C.

Authorised Person Electrical (Hazardous Areas) is to control in accordance with electrical Safety Rules and Procedures tables HAZ 1 & HAZ 2 of JSP 375 Volume 3 Chapter 3.

## **B.9 Works outside DSEAR Hazardous Zones**

Works and or tests at the control room or the standby generator house of Petroleum Installations, that are wholly outside of the DSEAR classified hazardous zones will not require a SI or PTW Petroleum and are to be managed in accordance with the Electrical Safety Rules and Procedures. This is to be determined at the planning stage by the Authorised Person Electrical (Hazardous Areas).

OA permission will be required for access and this shall be co-ordinated by the Authorised Person Petroleum.

*Note: there are many examples of Petroleum Installations at which the security fence encloses both areas classified as hazardous, and also a wider non-hazardous area which may contain such installations as control rooms and standby generator rooms. Works on such installations are usually in close proximity to the petroleum installation, and as they are within the security fence, is to be controlled as a minimum by the formal petroleum access procedures agreed for the establishment.*

# Gas Detection and Monitoring

## C1 General

- C1.1** It is a requirement of these safety rules and procedures to detect the presence, and concentration of flammable gases, oxygen and other hazardous substances identified in the AP Risk Assessment. This is needed to exercise the correct control over work within the petroleum hazardous areas. For this purpose, a Multiple Gas Indicator (MGI) is to be used. Testing for the presence and concentration of flammable gasses, oxygen and other hazardous substances is a requirement of these Safety Rules and Procedures when the need is identified by the AP Risk Assessment. Appropriate MGIs shall be used in conjunction with Table C1.
- C1.2** Readings are to be taken before the commencement of any work, and during the work, to check that the gas concentrations and other levels are within the limits stipulated on the Permit to Work, as determined from this document and the Safety Programme.
- C1.3** There will be a requirement for individual readings by the PiC, and joint readings carried out by the AP and the PiC. These joint readings must be taken simultaneously with separate instruments.
- C1.4** Test frequencies and responsibilities shall be in accordance with Table C2.
- C1.5** Individual MGIs must be maintained, calibrated and used in accordance with the manufacturer's instructions and a Quality Assurance System. All records of calibration are to be kept for reference purposes.
- C1.6** Those using gas detectors must be appropriately trained, competent and understand their limitations.
- C1.7** Permits to Work must stipulate the maximum gas concentrations applicable to the type of work to be undertaken. A separate Permit to Work must be issued for each part of the work where working practices or requirements alter the maximum permissible gas concentration e.g. changes from cold work to hot work.

## C2 Flammable Gas

- C2.1** The maximum permissible flammable gas concentration levels for differing work activities are contained in Table C 1.

## C3 Other Gases

### C3.1 Oxygen

- C3.1.1** The safe range for Oxygen percentage is 19 – 22%.

### C3.2 Hazardous Substances

- C3.2.1** Historical information concerning products utilised previously and details of the current product (Safety Data Sheets, manufacturer's information) should indicate whether other hazardous substances could be present. The hazardous nature of any substances that are introduced into the work area as a result of the requirements of the particular task and any possible reactions (the hazards of these substances must be identified to ensure that they do not react adversely with any other products present) must also be considered. The AP



Risk Assessment should consider this information to determine if other hazardous substances require monitoring. This may include Volatile Organic Compounds, Carbon Monoxide or Hydrogen Sulphide. The HSE document EH40, Workplace Exposure Limits (in conjunction with the Control of Substances Hazardous to Health Regulations (COSHH) (as amended)) contains the required limits for hazardous substances.

- C3.2.2** Tanks, vessels or confined spaces, which contain residual fuel oil, sullage, or waste fuels, may be contaminated by Hydrogen Sulphide. If the AP Risk Assessment identifies this risk, then it should be monitored and managed appropriately.

#### **C4 Response testing of MGI**

- C4.1** Instruments are to be “response tested” (sometimes known as a “bump test” or “field check”) before use (as a minimum unless manufacturer’s instructions are more stringent), in clear air conditions at or near the site of work to confirm their ability and response to expected gasses. This is done by exposing the MGI to a gas concentration that exceeds the high alarm set points. It should be done by applying a specific test gas to the MGI. The detail of the requirements for this test will vary between instruments; in all cases HSE requirements and manufacturer’s recommendations are to be followed.

#### **C5 Initial readings**

- C5.1** An Initial reading must be taken as follows:

- a. Immediately before the associated work/inspection
- b. Before entry into tanks or confined spaces
- c. When reaffirming
- d. When the AP decides it is necessary

#### **C6 Readings for open space work**

- C6.1** Readings should be taken at the location of the work, at any low lying locations such as drains, ducts, and excavations in the vicinity of the work. Readings should be taken at any temporary perimeters set up for the duration of the work; which must take into account the wind direction.

#### **C7 Reading within tanks or confined spaces**

- C7.1** Readings must be taken through the access point before entry. The AP is to be aware of the possibility of stratification of gases within undisturbed confined spaces.

- C7.2** On entering the confined space, areas liable to have higher gas concentrations e.g. pipeline entries, drain sump and low bottom plate levels on tanks, should be checked to confirm they are within the limits stipulated on the Permit to Work.

- C7.3** Pockets of combustible gas can be trapped under rust patches especially on the bottom plates of tanks. Any such patches should be removed by safe methods (determined by additional Task Risk Assessment) and further readings taken.

#### **C8 Readings for gas freeing operations**

- C8.1** There are two main purposes for taking gas readings during gas freeing operations;
- To confirm that the tested area is free from all hazardous and flammable gases.

- To establish whether normal minimum safety distances require extension. The aim is to achieve less than 1% of LEL at the boundary of the marked Restricted Area. If higher readings are recorded, the boundary must be extended.

**C8.2** If there is any wind, the readings to establish if a concentration less than 1% of LEL exists should be made at the Downwind Boundary (DWB) of the Restricted Area.

**C8.3** In still air conditions, readings must be made all around at the normal safety distance from the point of vapour emission and the restricted area boundary moved out if readings are not satisfactory.

**C8.4** The figures recorded on the Permit to Work and if necessary the Gas Concentration Continuation Sheet, are for the Down Wind Boundary (DWB), not the levels inside the confined space being ventilated.

**C8.5** It is the PiC's responsibility to monitor what is happening inside the confined space being ventilated and record their findings in accordance with local arrangements.

**C8.6** When ventilating confined spaces it may be necessary to switch off any ventilation arrangements (e.g. fans), before taking a reading in order for the atmosphere to stabilise. This will avoid the possibility of reading the gas concentration only in the ventilated air stream.

## **C9 PiC monitoring**

**C9.1** The PiC must continuously monitor the gas concentration whilst work is in progress within the confined space.

## **C10 Recording of readings**

### **C10.1 Recording of initial reading**

**C10.1.1** The highest initial reading obtained, simultaneously by the AP and the PiC using two instruments will be recorded immediately.

### **C10.2 Repeat readings**

**C10.2.1** The minimum frequency for recording readings is given in Table C 2.

**C10.2.2** These readings will be recorded on the reverse of the original Permit to Work or when necessary on the Gas Concentration Monitoring Sheet.

**C10.2.3** The highest intermediate LEL readings required to be taken will be recorded by the PiC and the highest and/or lowest Oxygen readings.

**C10.2.4** The highest confirmatory LEL readings required to be taken will be recorded by both the AP and the PiC and the highest and/or lowest Oxygen readings.

## **C11 Final readings**

**C11.1** For staged works the AP and PiC must carry out and record final readings. Final readings must be in accordance with the percentage gas readings required for the next stage of work.

**C11.2** Both the AP and PiC must carry out final readings, and they must agree that the combustible gas level is below 1% LEL before dismantling Restricted Areas.

**Table C 1 Flammable Gas Concentrations for Activities**

<b>TYPE OF ACTIVITY</b>	<b>READING (% of LEL)</b>	<b>REMARKS</b>
<b>(a)</b>	<b>(b)</b>	<b>(c)</b>
Entry to tanks, confined spaces and vessels, for visual inspection	Less than 20%	Entry of personnel for visual inspection only and use of tools is not permitted.
Sludge removal from tanks, confined spaces and vessels	Less than 20%	Entry of personnel for the removal of leaded or otherwise contaminated sludge.
Cold Work	Less than 10%	Any mechanical works where the tool or work piece temperature remain below 100°C
Hot work	Less than 1%	See definitions.
Electrical work/test	Less than 1%	Any intrusive work on electrical equipment in hazardous areas which can induce current and voltage to flow with the possibility of incendive sparks.
Grass Cutting at Class I and II installations	Less than 1%	Use of mechanically driven grass cutting devices in hazardous areas

**Table C 2 Minimum frequencies of recording readings**

<b>TYPE OF WORK</b>	<b>READING RECORDED BY</b>	<b>MINIMUM FREQUENCY THAT READINGS ARE RECORDED</b>
<b>(a)</b>	<b>(b)</b>	<b>(c)</b>
<p>1. HOT WORK</p> <p>a. Before commencement</p> <p>b. 2<sup>nd</sup> reading</p> <p>c. Intermediate readings whilst work proceeds</p> <p>d. Confirmatory test whilst work proceeds</p>	<p>AP and PiC</p> <p>AP and PiC</p> <p>PiC</p> <p>AP and PiC</p>	<p>Initial and before start of work daily</p> <p>Ten minutes after starting</p> <p>Hourly</p> <p>2 Hourly</p>
<p>2. ELECTRICAL WORK</p> <p>a. Before Commencement</p> <p>b. Intermediate Readings whilst work proceeds</p> <p>c. Confirmatory test whilst work proceeds</p>	<p>AP and PiC</p> <p>PiC</p> <p>AP and PiC</p>	<p>Initial and before start of work daily</p> <p>Hourly</p> <p>2 Hourly</p>
<p>3. CONFINED SPACES</p> <p>a. Before commencement</p> <p>b. Intermediate readings whilst work proceeds</p> <p>c. Confirmatory test whilst work proceeds</p>	<p>AP and PiC</p> <p>PiC (taken by entrant and communicated to PiC)</p> <p>AP and PiC</p>	<p>Initial and before entry daily</p> <p>2 Hourly</p> <p>4 Hourly</p>
<p>4. GRASS CUTTING CLASS I INSTALLATIONS</p> <p>a. Before commencement</p> <p>b. Confirmatory test whilst work proceeds</p>	<p>AP and PiC</p> <p>AP</p>	<p>Initial and before work starts daily</p> <p>Continuous testing with records for each potential point of release made at fifteen minute intervals</p>

TYPE OF WORK	READING RECORDED BY	MINIMUM FREQUENCY THAT READINGS ARE RECORDED
(a)	(b)	(c)
5. GRASS CUTTING CLASS II INSTALLATIONS  a. Before commencement  b. Intermediate readings whilst work proceeds  c. Confirmatory test whilst work proceeds	AP and PiC  PiC  AP and PiC	Initial and before start of work daily  4 Hourly  8 Hourly
6. COLD WORK  a. Before commencement  b. Intermediate readings whilst work proceeds  c. Confirmatory test whilst work proceeds	AP and PiC  PiC  AP and PiC	Initial and before start of work daily  3 Hourly  6 Hourly
7. GAS FREEING CLASS I AND II TANKS AND CONFINED SPACES  a. At commencement  b. 2nd Reading  c. Intermediate readings whilst gas freeing  d. During first 8 hours of gas freeing	AP and PiC  AP and PiC  PiC  AP and PiC	Initial and before start of work daily  Ten minutes after starting  Hourly  2 Hourly
e. After the first 8 hours e. Intermediate readings whilst gas freeing  f. Confirmatory test whilst work proceeds	PiC  AP and PiC	3 Hourly  6 Hourly
In addition to the above readings, the PiC must monitor the gas concentration continuously whilst work is in progress		

\* The frequency of readings may have to be increased in changeable weather conditions particularly when Class I products are involved.

## **C12 Equipment requirements for gas monitoring**

- C12.1** The monitor is to be selected from petroleum industry standard equipment, with proven effective use in the industry in similar application areas.
- C12.2** The equipment must be robust and suitable for use as a tool to aid maintenance operations, not simply a laboratory type scientific instrument, and must be portable.
- C12.3** The temperature and humidity range over which the instrument is required to operate should be specified to the manufacturer, who in return should state the operating range for their instrument.
- C12.4** A risk assessment should be conducted by the AP to determine the particular type of gases/products to be detected. This can form part of the initial site review.
- C12.5** The sensors must be suitable for the particular products to be monitored.

## **C13 Performance requirements**

- C13.1** The following features are considered to be a minimum requirement:
  - a. Audible and/or visual alarm, (minimum 85 db(A) at 1m, or above ambient sound levels), for the following items:
    - i. % LEL – Flammables
    - ii. % Oxygen
    - iii. PPM H<sub>2</sub>S (instant, TWA, STEL)
    - iv. Fault
    - v. Low-level battery
  - b. LEL, H<sub>2</sub>S and O<sub>2</sub> display
  - c. Continuous monitoring of product
  - d. An appropriate level of explosion protection for the potentially explosive atmospheres that it is to be subjected to
  - e. An appropriate level of environmental protection for the hazardous environment that it is to be subjected to
  - f. Confidence beep (normally every 30 seconds)
  - g. Robust outer casing to protect the instrument
  - h. Remote sampling probe
  - i. Backlit display
  - j. Scale calibrated in % for LEL, % for Oxygen
  - k. Parts per million (ppm) for Hydrogen Sulphide
- C13.2** When switched on, the following messages on the instrument should be displayed:
  - a. Due date for next calibration
  - b. Battery life remaining
  - c. Self-diagnostics check
- C13.3** Instruments should display the following marking:
  - a. CE mark
  - b. Intrinsic Safety Classification
  - c. ATEX Classification

**C13.4** Time waited average (TWA) for any other Hazardous Substance or gas identified by the AP risk assessment and in accordance with EH40.

**C13.5** Lower Explosive Limit setting shall be adjustable over the desired range via Multiple Gas Indicator keypad or PC/Laptop, access via user password.

**C14 Inspection requirements**

**C14.1** Prior to use, the AP must check that the Multiple Gas Indicator selected for use is fit for purpose. These checks include:

- a. The instrument is of the correct type for the gases to be monitored
- b. The total condition is acceptable e.g. no apparent damage and/or suitable for hazardous environment
- c. Indicator is within calibration date and an in-date certificate of calibration is available
- d. Indicator has been response tested in accordance with manufacturers recommendations
- e. Correct Lower Explosive Limit, Gas or Hazardous Substance Alarm setting has been applied
- f. Suitable remaining battery life remains for the proposed task

**C14.2** If there is doubt over the suitability of the proposed Multiple Gas Indicator then an alternative indicator must be used.

## **Personal Protective Equipment and Respiratory Protective Equipment**

### **D1 Personal Protective Equipment (PPE)**

The provision of PPE must be in accordance with the requirements of the Personal Protective Equipment at Work Regulations, 1992 (Health and Safety Executive ACOP L25). It is the employer's responsibility to ensure that suitable equipment is provided and must be selected as a result of risk assessments by the AP and the PiC. The minimum requirements for the type of PPE to be worn are stipulated in Table D2. The type required must be stated within the work sequence of the Petroleum Safety Programme.

The materials of any PPE for use where the risk is petroleum products must be certified by the supplier as fit to afford protection from exposure to the petroleum products or other harmful substances which are likely to be encountered. The suit, gloves and boots used in potentially explosive atmospheres must also be made from anti-static material.

The risk of exposure to petroleum products and the risk associated with regards to harmful chemical compounds vary depending on the task being undertaken, the petroleum product being exposed and the location. The class of PPE to be worn is to be in accordance with risk assessment.

There are a number of classes of PPE and these are outlined below:-

#### **a. Non Gas Tight Type 2**

A full suit with integral pressure hood all of light coloured material which meets the requirements of BS EN 943 part 1 Type 2 non-gas tight for connection to a continuous breathable air supply by PVC hose which are to the requirements of BS EN 14594. The suit shall meet the permeation by petroleum product in accordance with BS EN 14325 and BS EN 468. The gloves are of light coloured and meet the requirements of BS EN 374.

Type 2 Personal Protective Equipment is completed with boots, which are to meet the requirements of BS EN 345.

#### **b. Type 3 & Type 4**

Overalls complete with hood are to meet the requirement of BS EN 14605. type 3 and type 4, and can be used with a separate air hood or blouse for use with air line mask fed from air bottles' or with fall face mask to BS EN 137. The selection of RPE is to be in accordance with HSG 53. Gloves which meet the requirements of BS EN 374 and are to be suitable for the task they are applied to. Knee high boots which are to meet the requirements of BS EN ISO 20345.

#### **c. Basic PPE**

Flame retardant overalls correct to BS EN ISO 11612 and gloves which meet the requirements of BS EN 374 and are suitable for the task being undertaken.

### **D 1.1 Wearing and Cleaning**

The requirements of this document must be observed when dressing into, removing, and cleaning Personal Protective Equipment. The requirements for washing after use of the equipment are to be in accordance with manufacturer's recommendation.



## **D 1.2 Maintenance**

The employer and employee are responsible for Personal Protective Equipment and other Safety Equipment (e.g. harnesses, rescue lines). For example, the Authorised Person Petroleum must ensure that equipment provided by the MMO is regularly inspected to ensure that it is safe for use. Equipment must be inspected daily whilst in use, and otherwise, at monthly intervals. A record of the monthly inspection and any servicing is to be kept in PIDR where the equipment is provided by the MMO.

## **D 2 Respiratory Protective Equipment (RPE)**

### **D 2.1 Classification**

There are two distinct types of respiratory protective equipment devices:

- **Filtering devices:** These purify the ambient air to be breathed using filters able to remove contaminants in the air.
- **Positive Pressure Breathing Apparatus:** These supply the wearer with breathable air from either compressed air line or compressed air cylinders worn by the wear from an uncontaminated source and shall comply with the requirements of BS EN 12021 regarding quality of the air

### **D 2.2 Equipment Standards**

All RPE must conform to the legislative requirements of BS EN 529:2005 (E) and HSG 53 Respiratory Protective Equipment at Work or any subsequent updates.

All breathable air shall be from sources which have been tested in accordance with BS EN 12021.

It is the responsibility of the equipment owner to ensure that the equipment complies with the above, and to provide written evidence of compliance. If written evidence cannot be provided, the equipment must not be used.

### **D 2.3 Correct Grade of RPE**

The correct grade of RPE is to be selected and worn as a result of RPE assessments completed by the PiC or MMO for self delivery in accordance with HSG 53.

The PiC or the person within the MMO organisation responsible for managing/supervising the works activity shall provide to the AP, the completed RPE assessments based on the current Material Safety Data Sheet (MSDS) for the product being exposed and any materials or chemical compounds identified as requiring RPE. The assessment shall take into account the points identified at D3.1 of this document.

These assessments shall be produced either using the on-line RPE selection tool available from NHS Health Scotland (<http://www.healthyworkinglives.com/rpe-selector>) or by the RPE equipment manufacture/supplier.

The minimum requirements for the type of RPE to be worn are stipulated in Table D2. The type required must be stated within the work sequence of the Petroleum Safety Programme.

### **D 2.4 Training in the Use of RPE**

The employer should ensure that supervisors, wearers and others involved in the maintenance and use of the devices receive suitable training. Refresher training should be provided as necessary, this should be at least annually unless otherwise decided by individual risk assessment.

### **D 2.5 Wearing of RPE with Spectacles and Beards**

A good face seal cannot be achieved with the face piece by a person wearing normal spectacles or facial hair. Alternative RPE such as a full suit and or hood; is to be used when a poor seal is indicated. Fitting should be undertaken in accordance with HSG 53.

### **D 2.6 Disinfection of RPE**

All RPE must be cleaned and disinfected after use in accordance with manufacturers' instructions. The equipment should be stored in accordance with the manufacturer's instructions.

### **D 2.7 Use of Cylinders**

Compressed air cylinders in use in a confined space must be provided with a protective cover. This removes a possible source of a spark particularly from steel cylinders, and prevents accelerated corrosion of any damaged areas of the cylinders. The protective covers can normally be supplied by the cylinder supplier.

A system of control must be in place for the use of Breathing Apparatus supplied from cylinders or other containers, in order to ensure that work is contained within the limited available supply period.

### **D 2.8 Maintenance of RPE**

Where RPE is provided for use, a system of inspection and maintenance must be put in place in accordance with HSG 53. The system should include inspection for correct functioning before and after each occasion of use, and also at monthly intervals. A record of the monthly inspections and servicing shall be made available to the AP. Where the equipment is the property of the MMO, then adequate maintenance and usage records are to be maintained in accordance with the requirements of HSG 53

Servicing is to be limited to that detailed in the manufacturer's user manual, and no attempt is to be made to replace components or make adjustments or repairs beyond the manufacturer's recommendations. Valves and regulators must be returned to the manufacturer at the intervals stipulated for servicing, repair and calibration. Evidence of fitness for use must be available for each set of RPE for presentation to the AP on request.

The AP must ensure that the above system is in place for equipment which he issues. It is important to note that any site maintenance conducted on RPE must be carried out by a competent person.

### **D 2.9 Canister Filters**

Canister filters conforming to BS EN 141 (Specification for gas filters and combined filters used in RPE), for use with full face masks, fall into two general types:

- A – Single use – A fresh filter canister is to be unwrapped and fitted to the full face mask each time it is used.
- A2 – Replace on judgement – Used for a maximum of 30 hours in the contaminated environment or 6 months after removal from packaging, or if the wearer feels any adverse effects. Records are to be kept to establish the usage of this type of canister.

### **D 2.10 Air hoses**

#### **D 2.10.1 Examination**

All air hoses are to be examined daily before and after use for physical deterioration, e.g. cracks, holes or thinning of walls due to abrasive wear. Hoses found to be defective must be immediately withdrawn from service and repaired or discarded as applicable. Any such withdrawals, repairs or disposal should be recorded.

#### **D 2.10.2 Recording of Use**

A record must be kept of the number of hours air hoses are used on leaded tanks. After 100 hours use on leaded tanks, the hoses should be scrapped and this should be recorded. Hoses must be disposed of as hazardous waste.

#### **D 2.11 Use of contractors' air hoses and compressors**

Where employees are required to use Contractors' air hoses and air compressors, they are to obtain written confirmation before using the equipment, from the PiC that the equipment conforms to the requirements of HSG 53, BS EN 529:2005 (E), BS EN 270:1994, BS EN 14594, BS EN 14953 and the air quality has been tested in accordance with BS EN 12021.

### **D3 GUIDANCE IN THE USE OF RPE AND PPE**

#### **D3.1 Selection of RPE and PPE**

In selecting RPE and PPE the following factors should be taken into consideration:

- Types of work to be undertaken.
- Period time the PPE is exposed to 'Wet' work with the product or chemical compounds
- Frequency of use.
- Quantities and type of suitable equipment.
- Suitability/range of application of equipment.
- Health precaution detailed with MSDS (R or H phrases)

#### **D3.2 Use of Open Circuit Breathing Apparatus**

In the circumstances described in the preceding paragraph, the use of Positive Pressure Open Circuit RPE when used with Type 3 & 4 PPE, with air bottles carried by the wearer, or from bottles mounted on a cradle, should be considered. This type of equipment obviates the need for compressors, and air and water filters which are required when constant flow type apparatus is used.

#### **D3.3 Conditions Requiring the Use of Type 2 PPE**

Type 2 PPE which incorporates RPE must be used for cleaning and maintenance work in tanks currently storing leaded fuels.

Appropriate quantities of this type of equipment should be kept for such conditions. In assessing the appropriate quantities the following circumstances should be taken into consideration:

- a. changeover from Aviation Leaded Gasoline fuels to AVTUR
- b. entry into leaded fuel tanks is much less frequent for other tasks, with the main exception of tanks at large MOD installations, and the periodic inspection of AVGAS installations

#### **D3.4 Respiratory Protective Equipment for Work Outside Tanks**

The criteria for renewal of the filters is subjective, the wearer must leave the contaminated area, and remove the RPE and replace the filter when there is an indication of the onset of additional breathing

effort. There is a need to record the period of use of RPE used for gas or vapour elimination. It is necessary to change filters before they become saturated with the gas or vapour, rather than attempt to rely on the user's sense of smell to detect the onset of saturation.

Such equipment must not be used by personnel who have a temporary or permanent problem with their sense of smell. The filter media is detailed in HSG 53 and annex C to BS EN 529:2005 (E) or any subsequent updates and the manufacture of the filter cartridges.

**Table D1: Combinations of PPE and RPE**

PPE	RPE
<b>Non-Gas Tight Type 2</b>	
<b>Type 3 &amp; 4</b>	<b>By Assessment in accordance with HSG 53</b>
<b>Basic PPE</b>	<b>By Assessment in accordance with HSG 53</b>

**Table D 2: Hazardous situations and minimum requirements of RPE and PPE**

HAZARDOUS SITUATION	RPE GRADE	COMMENTS ON PPE
Entry to a Class I petroleum product tank for work.	Type 2	Gas tight suit enclosing the entire body
Risk of exposure to a major spillage of Class I petroleum liquid.	Type 2	Gas tight suit enclosing the entire body
Leaded or other toxic sludge in tanks.	Type 2	Gas tight suit enclosing the entire body
Leaded sludge outside of tanks.	Determine by RPE Assessment	Type 3 & 4 chemical resistant suit
Exposure to FSII within FSII tanks.	Type 2	Gas tight suit enclosing the entire body
Entry to AVTUR-F34 & AVCAT – F44 tank which has water bottom (possible high FSII concentration)	Type 2	Gas tight suit enclosing the entire body

HAZARDOUS SITUATION	RPE GRADE	COMMENTS ON PPE
Exposure to AVTUR-F34 & AVCAT – F44, for example, working on drained but open filter vessels, including the handling of elements.	Determine by RPE Assessment	Likelihood of dripping, splashing or spraying liquid petroleum product will determine grade of PPE required by risk assessment.
Entry to any tank with a gas reading of over 1% LEL for the purpose of cleaning or work for extended periods.	Type 2	Gas tight suit enclosing the entire body
Inspection of tanks or work of short duration (less than 15 minutes) when the gas level is above 10% of LEL	Determine by RPE Assessment	Likelihood of dripping, splashing or spraying liquid petroleum product will determine grade of PPE required by risk assessment.
Entry to fully drained, clean and well-ventilated tank or confined space with gas concentration reading less than 1% LEL, and with an oxygen level within permissible limits.	Breathing Apparatus may not be required. However Working in Confined Spaces Regulations 1997 still apply.	The RPE is the principal requirement, anti-static Personal Protective Equipment is required.
Exposure to petroleum products in outside conditions where the gas concentration is above 1% LEL	Determine by RPE Assessment	Likelihood of dripping, splashing or spraying liquid petroleum product will determine grade of PPE required by risk assessment.
Exposure to petroleum products in outside conditions where the gas concentration is below 1% LEL	Breathing Apparatus may not need to be worn, but may be required at hand in case of elevated gas concentrations during work	Likelihood of dripping, splashing or spraying liquid petroleum product will determine grade of PPE required by risk assessment.
Exposure to FSII additive outside the tank, working on injection equipment and pipework.	Determine by RPE Assessment	Likelihood of dripping, splashing or spraying liquid petroleum product and additive will determine grade of PPE required by risk assessment.

# Guidance on Grass Cutting

## E1 Introduction

**E1.1** Grass and vegetation, especially in dry conditions, represent an increased risk of fire at Petroleum Installations. Wherever possible they should be permanently removed from the hazardous area; where this is not possible the procedures in this annex must be followed.

**E1.2** This annex provides guidance for grass cutting within the defined hazardous areas of Petroleum Installations on the MOD estate, and should be read in conjunction with part 1 of this Chapter.

## E2 Procedures

**E2.1** Grass cutting is to be controlled by the use of a Permit to Work and the appropriate gas monitoring regime as detailed in table C2 to Annex C.

## E3 Works planning

**E3.1** Planning of works prior to grass cutting is required by the AP and prospective PiC.

**E3.2** This will require an AP Risk Assessment. A Safety Programme will not normally be required for grass cutting unless the AP identifies a requirement for isolation.

**E3.3** It is acceptable for the prospective PiC to use a generic Task Risk Assessment and Method Statement grass cutting providing the following requirements are met:

- a. Only one service provider has been contracted to undertake grass cutting within the petroleum hazardous areas for a specific site
- b. The PiC has been appointed as a SkP
- c. Task Risk Assessment and Method Statement are provided by the Contractor and reviewed by the AP prior to the issue of a Permit to Work
- d. Should the AP consider the Task Risk Assessment and Method Statement inadequate a Permit to Work will not be issued until these documents have been amended to the satisfaction of the AP.
- e. The AP is to record in the PIOR that the Task Risk Assessment has been reviewed and is acceptable
- f. Task Risk Assessment provided defines relevant hazards, risks and control measures to be taken against each Method Statements Method Statement must cover the procedure to be followed for grass cutting on each class and type of fuel installation within the site
- g. The Contractor is to revise the generic Method Statements should work practises alter
- h. Copies of the generic Task Risk Assessments and Method Statements are to be retained in the PIDR

## E4 Points of gas readings

**E4.1** Prior to commencement of grass cutting the AP and the prospective PiC are to walk the area where the grass is to be cut, to identify any hazards that may restrict the grass cutting operation. This would include potential fuel leaks, and incomplete works by others such as open trenches; any additional hazards identified may require a separate risk assessment to be raised.

**E4.2** The AP is to undertake readings at any high risk areas which exist in close proximity to sources of vapour release such as tank vents. Low points such as fuel pits are to be

inspected and tested for vapour. All gas readings must be below 1% of the Lower Explosive Limit.

**E4.3** The AP and prospective PiC must record the highest reading of the two MGIs used on the Permit to Work; repeat readings are to be taken in accordance with table C 2 to Annexe C.

**E4.4** If during repeat gas tests a reading above 1% LEL is experienced, work is to cease, and grass cutting equipment withdrawn. The team other than the PiC must also withdraw until such time as the readings reduce to below 1% LEL.

## **E5 Grass cutting on Class I Installations**

**E5.1** With Class 1 petroleum products the possibility of vapour drift from potential sources of release must be assumed during grass cutting, even when all transfer operations have stopped.

**E5.2** Internal combustion engine driven grass cutters can be used providing the following procedure can be followed:

- a. All petroleum transfer operations that could cause a vapour hazard are to cease
- b. All OA's personnel are to be withdrawn from the hazardous area
- c. Combustible gas levels remain below 1% LEL

**E5.3** Where the procedure in E5.2 cannot be followed internal combustion engine driven grass cutters cannot be used.

**E5.4** Electrically driven grass cutters are not to be used.

**E5.5** The AP and PiC must remain on site whilst grass cutting is in progress.

**E5.6** The AP must continually monitor combustible gas readings at the risk locations.

**E5.7** The AP must record the combustible gas readings as per table C2.

## **E6 Grass cutting on Class II Installations**

**E6.1** Class II petroleum products are less volatile than Class I and internal combustion engine driven grass cutters can be used providing the following procedure can be followed:

- a. All petroleum transfer operations that could cause a vapour hazard are to cease
- b. All OA's personnel are to be withdrawn from the hazardous area
- c. Combustible gas levels remain below 1% LEL

**E6.2** Where the procedure in E5.2 cannot be followed internal combustion engine driven grass cutters cannot be used.

**E6.3** Electrically driven grass cutters are not to be used.

**E6.4** The PiC must remain on site whilst grass cutting is in progress.


**E6.5** The PiC must monitor combustible gas readings at the risk locations as per table C2.

**E6.6** The PiC, and where required AP, must record the combustible gas readings as per table C2.

**E7 Grass cutting on Class III Installations**

- E7.1** There are no requirements to control grass cutting under these Safety Rules and Procedures at installations containing Class III fuel products and no restriction on grass cutting equipment as long as the products remain unheated.



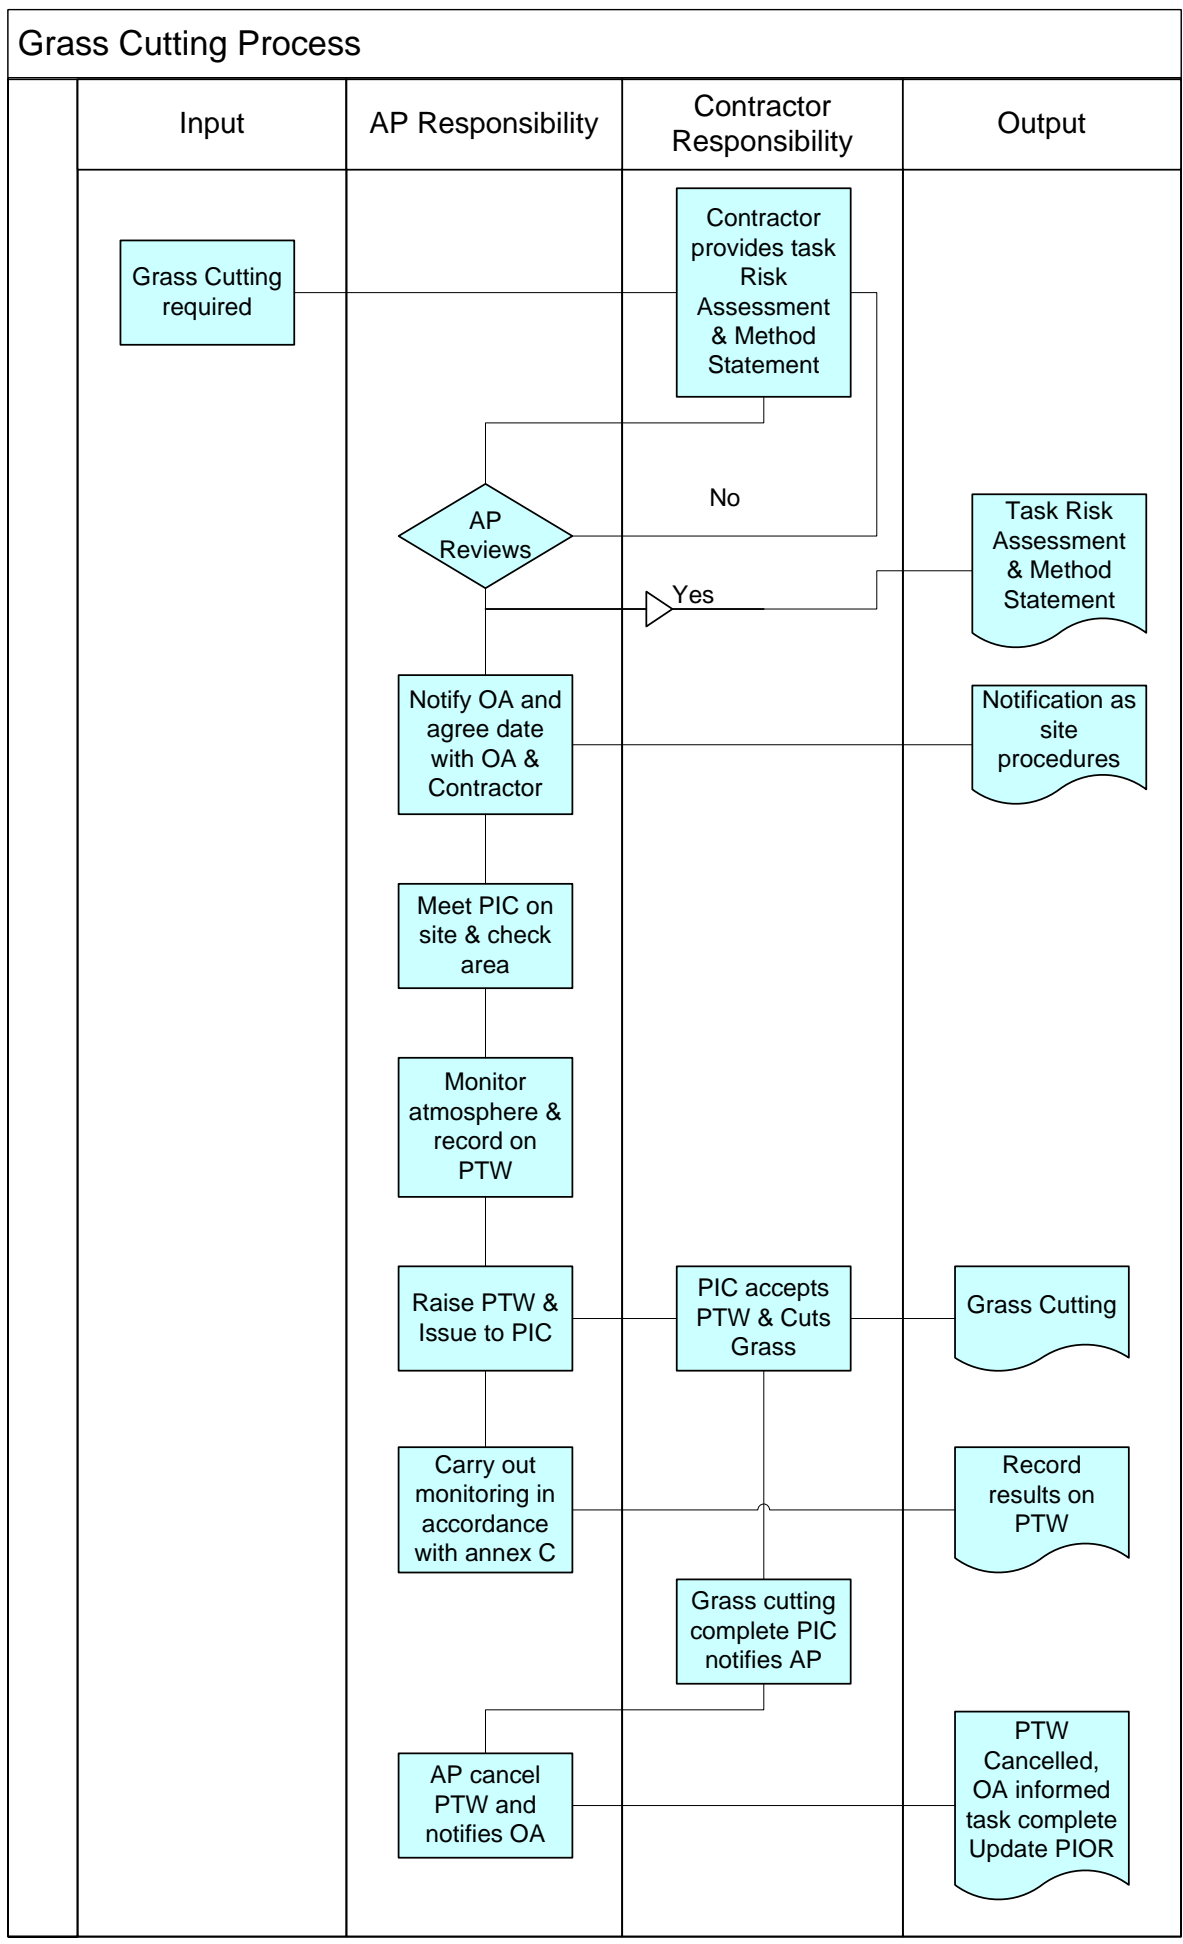

# Guidance on Restricted Areas

## F1 Determination of Restricted Areas

The extent of safety distances at different types of petroleum installation and the distances from uncontrolled areas are clearly defined for hazardous areas depending on the class of petroleum product handled and the type of installation concerned. These distances are determined by the OA.

In restricted areas there may well be variables, depending upon the type of work carried out and the particular circumstances prevailing, that make it impractical in all cases to follow the same precise distances defined for the boundaries of hazardous areas. The extent of a restricted area requires individual interpretation on a case to case basis. The guidance given in this Annex relates to the principal factors involved, and is intended to assist those responsible for determining the extent and any special requirements of a restricted area.

### F1.1 Dispersal of Gas

The dispersal of flammable gas in air, to the extent that it ceases to be flammable, must be considered in relation to sources of possible ignition. It is essential that all factors that may influence the assessment of a restricted area are fully examined to ensure that the likely simultaneous existence of flammable gas/air mixture, together with a source of ignition, cannot occur. This can best be achieved by logical and progressive analysis taking into consideration all of the possible factors which may be involved.

#### Setting Up a Restricted Area

Normally a Restricted Area is established to accomplish a planned task. However, the possibility exists for such an area to be established in an emergency.

#### Planned Work

A restricted area must be set up when the works are being controlled under a Permit to Work or when excavation works are being undertaken and there is a risk that petroleum liquid or vapour may be present in the surrounding ground.

## F2 Emergency Situations

### F2.1 Sources of Escape of Petroleum

All means must be taken to avoid sources of release and to prevent accidental escape. Whenever possible, any unavoidable escape of flammable liquid should be limited to the minimum quantity thus limiting the associated vapour, vapour spread, and risk. Where accidental releases occur, a Restricted Area will be required to control the area where the release has taken place.

### F2.2 Cessation of Operations

Many sources of release of vapour and spillage of liquid petroleum can occur at installations during normal operations. Typical sources of release include: release from vents on tank filling, filling of lorries and containers, and leaks from seals of pumps. For this reason all operations must be stopped in a restricted area, and personnel removed from the area, to avoid the reintroduction of a petroleum risk to an area has been made safe. There is also the

basic safety requirement that operations must cease to permit isolation, and to prevent accidental releases during maintenance.

Consideration must also be given to any contingent operation carried out by the OA adjacent to the restricted area, which could result in a release of gas into the area or introduction of a source of ignition. Such operations depending on circumstances must be stopped, to enable the works activities to be conducted safely.

### **F2.3 Site and Weather Conditions**

These can play an important part in the safety of works and the safety consequences of works action. Consideration must be given to both site and weather conditions including the following:

- a. Type of petroleum product involved
- b. Presence of valve and drainage pits, drains and ducts
- c. Excavations and nature of ground surfaces and gradients
- d. Proximity of public thoroughfares
- e. Proximity and nature of adjacent operations

In assessing weather conditions, account should be taken of wind direction, velocity and the potential for electrical storms. The AP should be prepared to react to changes in conditions. A change in wind direction may cause a change in the boundary of the restricted area.

Escaped petroleum gas, although heavier than air, may be carried upwards by wind currents, and in still air conditions, may linger. The latter presents a very serious risk at low levels. The potentially hazardous area that can be formed may therefore vary during the period of the planned work or the emergency situation, and must be monitored. Wind direction and strength should be determined by the use of a wind indicator located at high level, or in an exposed position free from shelter from the wind in any direction.

Wind direction must also be determined so that sources of air required for Breathing Apparatus and other equipment can be situated in an up wind location.

### **F2.4 Extent of Restricted Area**

#### **F2.4.1 Method of Measurement**

Normally the minimum extent of areas will be as for hazardous areas and be measured at a radius prescribed horizontally from the outer limits of the location when a hazardous atmosphere could occur and should be defined as follows:

- a. Class I product installations - 15 metres
- b. Class II and III installations - 6 metres
- c. Filling and Service Stations metering pumps/dispensers - 4.25 metres (For hot work a minimum of 6 metres is required)

The minimum extent of the restricted area should be measured from the source of petroleum release or the edge of a potential spillage area.

#### **F2.4.2 Extent of Areas for Gas Freeing**

The large volume of petroleum gas and air mixture released during gas freeing operations, particularly when highly volatile Class I product is involved, may result in gas concentrations above 1% of Lower Explosive Limit spreading beyond normal safety distances in certain weather conditions. This situation is unlikely when Class II petroleum is involved, but could occur in certain conditions such as when gas freeing above ground tanks in hot climates.

In still air conditions, gas concentrations above 1% of Lower Explosive Limit are more likely to spread at low level beyond the normal hazardous area safety distances. This situation is therefore the most hazardous for gas freeing operations.

Gas concentrations must be carefully monitored at the boundaries of normal Restricted Areas, particularly at the commencement of gas freeing operations, and during the first 8 hours (see Annex C). Action must be taken before commencement of gas freeing operations to eliminate any possible sources of ignition as far as reasonable and practicable in the immediate areas surrounding the normal safety distance for the hazardous area, including downwind boundaries in windy conditions.

Additional warning signs and markings must be readily available should extension of the Restricted Area be required.

### **F2.4.3 Conditions during Gas Freeing Operations**

Maintenance, operation or any other type of work is not permitted in a restricted area whilst the gas freeing of Class I and II Petroleum Installations is in progress.

#### **Removal of Sources of Emission of Gas**

In circumstances where it is not practicable to meet the safety distances from the source of emission of gas described in F2.4 of this Annex, it may be possible to move such a source to a safe distance through extension to vents and pressure release valves. The AE should be contacted for guidance where safety distances cannot be met.

#### **Health Risks from Petroleum Vapour**

The presence of petroleum vapour can present a health risk, as well as an ignition risk. The AP must be aware of the potential risks of exposure of personnel to petroleum vapour and provide direction to the PIC on the Permit to Work. Particular care is required with Class I products due to the risks of exposure to highly volatile organic lead compounds (toxicity), as well as the risk of the petroleum vapour (flammability).

In cases of doubt on the matters described in the setting up and assessment of Restricted Areas, the AE should be consulted.

# AP Petroleum Risk Assessment

## G1 Introduction

This annex provides guidance on Petroleum risk assessment.

## G2 Classification of Principle Petroleum Products

- a. The principle petroleum products found on the MOD estate and their classification are controlled under these safety rules and procedures. Should there be doubt on product identification or class, after referencing the safety data sheets then the AE should be contacted for further guidance.
- b. The AP should ensure the availability of the safety data sheets for the petroleum products for their installations being controlled under this Chapter. The safety data sheets and all relevant COSHH information shall be made available by the site OA. This information will form a basis for the risk assessment and the determination of the level of control of the works activity. Current safety data sheet should be held in the PIDR.
- c. There may be conditions or countries where ambient temperatures are high enough for the handling temperature of Class II or Class III petroleum products to be above the respective flash point classification. In these circumstances the condition must be assessed and where necessary the product classification raised. Where petroleum products of different classes are mixed, the mixture is classified as the liquid having the lower flash point, unless flash point determination tests show otherwise.

## G3 Hazards

The principal hazards associated with conditions and procedures covered by these Safety Rules and Procedures are:

- a. Petroleum liquid product
- b. Petroleum vapours
- c. Static electricity
- d. Electricity
- e. Hydrogen Sulphide
- f. Micro-Biological contamination
- g. Confined spaces
- h. Additives
- i. Other hazards should be considered which may include but not limited to; access and egress, moving vehicles and working at height

## G4 Risks

The principal risks associated with the above hazards are:

Fire/Explosion

- a. As well as from residual product, a fire and explosion hazard may also arise from the work process. For example if solvents are utilised for cleaning purposes, or coatings applied to steel work which may be oil based or any other flammable material which may give off sufficient vapours to form a flammable mixture.

#### Respiratory

- a. Respiratory hazards can be present in many forms, including toxic vapours, particles from welding, painting and other procedures undertaken. These can result in potentially serious pulmonary conditions and other ill health problems.

#### Asphyxiation

- a. Through inflow of fluids, oxygen deficiency

#### Oxygen Deficiency/Enrichment

- a. Oxygen deficiency (below 19% by volume) can be caused by the presence of other gases (inert gases), the rusting of bare metal surfaces and microbial action depleting the oxygen level. Damp or humid conditions in a tank and the use of naked flames can also reduce oxygen levels.
- b. Oxygen enrichment (above 22% by volume) can be caused by operations which involve equipment using oxygen, e.g. oxy-acetylene cutting, when leaks from equipment or supply hoses can occur. The release of oxygen to the confined space must be avoided, through proper equipment maintenance and correct operating procedures.

#### Poisoning/Toxicity

- a. Can be from direct handling of the product and ingestion resulting from poor personal hygiene, incorrect use of RPE/PPE or inadequate RPE/PPE. This can result in breathing problems from inhalation and dermatitis/skin disease or complaints from direct contact.

#### Dermatitis/Skin disease or complaints

- a. Medical checks, personal hygiene and PPE (controls not risks). Can be from direct handling of the product, incorrect use or inadequate PPE.

#### Environmental

- a. Environmental contamination of the soil and of water courses can result from release of product if not suitably contained. Mitigation measures should be considered at the planning phase and include careful isolation and draining and following spillage procedures.

#### Electricity

- a. All electrical equipment should be isolated. Can result in electrical burns, shock and death. All electrical equipment must be isolated.

#### Micro-Biological

- a. Micro-organisms, when present in petroleum products, can proliferate when in contact with water or sludge at tank bottoms. There is also a possibility of microbiological growth in the form of slime on the tank walls at the interface of the water bottoms and underlying water itself.

- b. When such contamination is suspected or found, an additional risk assessment must be carried out.

#### Temperature

- a. Heat stress risks can develop through elevated temperatures when working within confined spaces, working in PPE/RPE and/or created by the work process itself.

### **G5 Considerations**

The following is a summary of areas to be considered when preparing the AP Risk Assessment:

- a. Biological
- b. Chemical (chemicals present, chemical reactions)
- c. Electrical (electric shock, plant isolation, incendive sparks)
- d. Environmental (spillage, contamination)
- e. Explosion (ignition sources, flammable mixture)
- f. Fire (ignition sources, vapour, gases, fire appliances)
- g. Flow (plant isolation)
- h. Plant (weight, size, location, access/egress)
- i. Poisoning
- j. Pressure (uncontrolled release, controlled release)
- k. Temperature (of fluids and equipment/plant items)
- l. Emergency Procedures including:
  - i. Rescue (access, egress, equipment)
- m. Type of fuel
  - i. Hydrogen sulphide may be present.
  - ii. May contain additives, e.g. 'FSII', which is a toxic additive in aviation fuel.
  - iii. Flash point.
- n. Type of storage tanks
  - i. Entry points, area of work, pipework connections, heating coils, suction points, floating arms, top hatches, side entry doors and cathodic protection fitted.
- o. Ancillary equipment.
  - i. Pump units, electrical and mechanical isolation.
  - ii. Tank gauging systems, temperature gauges, alarm and level control devices,
  - iii. Remote operated valves.
- p. Work Methods
  - i. Type of cleaning method

#### **G5.1 Cathodic Protection Systems**

Where works are carried out on fuel installations installed with a cathodic protection system the following must be considered during the planning stage:

- a. Before any break is made in cathodically protected metallic pipelines or plant, the impressed current system is to be switched off and disconnected 24 hours before commencement of the work.
- b. Both sides of the intended pipeline break are to be electrically bonded together and earthed. It is important that electrical continuity is maintained throughout cathodically protected pipelines or plant to prevent the formation of incendive sparks during maintenance.

## **G5.2 Electrical Storms**

The likelihood of electrical storms should be checked prior to commencement of, and during, work, as when they occur, all work must be stopped and all personnel, tools, plant and equipment withdrawn from the area. When there is a high risk of electrical storms prior to start of work, consideration should be given to the risks posed in commencing the task.

## **G5.3 Fire Precautions**

When hot work is to be conducted at Petroleum Installations, risk assessments shall consider the necessary fire precautions relevant to the site. Co-ordination of works activities between the OA, AP and the base or local authority fire and emergency services shall be undertaken.

## **G5.4 Confined Spaces**

When entry to a confined space is required on a petroleum installation, risk assessments shall consider the necessary precautions that need to be taken to enable safe access, working and egress. This will depend on the confined space and the works to be undertaken. The AP and PiC shall also ensure an emergency and rescue plan forms part of the risk assessment process.

## **G5.4 Tank Cleaning**

Tank entry, gas freeing and internal cleaning of the tank are probably the most hazardous works undertaken on a petroleum installation. The decision to proceed with any work requiring tank entry, and the prerequisites prior to tank entry must be properly planned and include the reinstatement of the installation to its normal operating condition.

## **G5.5 Petroleum Works Safety Checklist**

A checklist (PET 06) to assist APs undertaking this task is included in Part 3. The checklist is for work on Petroleum Installations holding fuels and their respective additives. It does not cover work on tanks containing other chemical products in their concentrated form such as anti-freeze compounds, icing inhibitors and specialist compounds.



### Medical Requirements

- H1** There are two aspects for medical requirements when working on Petroleum Installations on the MOD Estate.
- a. Medical or health fitness of the personnel carrying out the work
  - b. Medical or health surveillance of all personnel
- H2** The referenced regulations require all work to be risk assessed by a competent person; there is a requirement on the employer to consider the health, fitness and condition of an employee to perform a particular task.
- IH3** Assessing the hazards to health for personnel in Petroleum Installations is particularly important when working in tanks.
- H4** The following factors should be considered for the wearers of personnel protective and respiratory protective equipment:
- a. Total fitness of wearer
  - b. Lung-function
  - c. Respiratory disorder
  - d. Tendency to claustrophobia
  - e. Mobility and agility.

#### **H5 Total Fitness for RPE Use**

Everyone who wears RPE must be endorsed medically fit prior to commencement of work, and is to produce certification to that effect with their competence documentation. The medical certification must be completed by a qualified medical practitioner.

#### **H6 Surveillance**

All personnel who are exposed to substances hazardous to health should have in place, as identified by the risk assessment, a health surveillance programme. This should be drawn up by the employer, with guidance from the occupational health advisor.

## Signs, Notices and Posters

### I1 Poster

The requirement for the provision of a Petroleum Safety Poster has been removed and is replaced by a Petroleum Safety Rule Book, which is extracted from JSP 375 Volume 3 Chapter 5 Petroleum Installations.

### I2 Permanent Notices

#### I2.1 Hazardous Areas

It is the responsibility of the OA to ensure that permanent notices, warning of petroleum hazards and risks are prominently displayed on all approaches to Petroleum Installations, to warn all those entering the facility of the hazards and control measures. This will be the OA/Hazardous Area Manager/Establishment defined hazardous area, usually fenced or enclosed with access control; as opposed to the DSEAR Hazardous Area, defined by its respective zones.

JSP 317 - Joint Service Safety Regulations for the Storage and Handling of Fuels & Lubricants details that whenever petroleum products are stored or handled, even in small quantities, hazardous conditions can arise. The extent of all hazardous areas is therefore to be clearly indicated by the use of notices such as for Class I installations 'PETROLEUM SPIRIT – HIGHLY FLAMMABLE – NO SMOKING – NO NAKED LIGHTS' conspicuously displayed in the appropriate languages, with other appropriate hazard warning and supplementary signs conforming in shape, size and colour with the requirements of the Health and Safety (Safety Signs and Signals) Regulations. Examples of the appropriate signage may be found in the current edition of JSP 317 and DEFSTAN 05-52 Part 1 and 2..

#### I2.2 Leaded Fuel Tanks

A permanent notice must be displayed for all those tanks which have contained leaded fuel and fall within the leaded fuel tank definition. Such tanks include those which currently contain leaded or unleaded gasoline, and those tanks which have contained leaded or unleaded gasoline in the past, and have not been treated to establish a lead free condition. The notice currently employed (see Figure 1) is as detailed below with the wording "Danger this tank has contained leaded gasoline" and, "Do not enter unless prescribed regulations are complied with".



Figure 1 Example sign – Leaded Tanks

### I3 Temporary Notices

#### I3.1 Restricted Area Notices

Temporary notices are to be displayed at the points of access at all locations where restricted area maintenance work is being conducted.

Temporary notices are to be held at each location with a responsibility for maintenance of Petroleum Installations. The notice currently employed (see Figure 2) is as detailed below with the wording "DANGER - RESTRICTED AREA MAINTENANCE WORK IN PROGRESS - NO ADMITTANCE WITHOUT AUTHORITY"



**Figure. 2 Example sign – Maintenance Work in Progress**

## **Works Organisation at Product Receipt Enclosures**

**J1** The Product Receipt Enclosure (PRE) contains the equipment associated with the termination of the supply pipeline to the base. The operating agency arrange the operation and maintenance of the off base pipeline system, with pipelines operated by one of a number of contractors.

### **J2 Defining Responsibility for Equipment**

As defined the PRE should be an enclosed area (although there are examples where this is not the case). In addition, there can be on base facilities which are the responsibility of the base for operation and maintenance, located in the PRE.

There is a need to formally establish the lines of demarcation of the facilities, the operational and maintenance responsibilities, and the co-ordination and co-operation of all parties when works are required.

A written statement should be secured from the pipeline operator, defining the equipment which is his responsibility. The operating agency is required to notify the customer when works are to take place at the PRE, so that the implications of such works for the base/establishment can be assessed. Equally, it is necessary to advise the pipeline operator when works are planned on fuel installations in the proximity of or directly related to the PRE.

### **J3 Communications prior to Works at the PRE**

Strong operating links are required between the Establishment, and the pipeline operating company. Formal communication between the pipeline operator and the Establishment should be engaged at the planning stage for all works activity at the PRE, and for all works activity on-base facilities which have an impact on the PRE, due to the proximity of the works or otherwise. The aim of this communication in the works context is to ensure that unsafe conditions are avoided. For example, gas freeing an airfield tank, whilst hot work is being performed at a nearby PRE.

The pipeline operating company will control works at the PRE using their standard safe system of work.

### **J4 Management of the Risks of Works at the PRE**

The Establishment must have time and opportunity to consider the effect of the works at the PRE on other petroleum installation works on site, with cooperation between all stakeholders. The details/consequences of the works for an assessment of the general effect on operations at the establishment must be provided to those with total base operational and safety responsibilities.

## Definitions

### **K1 General – Common Requirements**

Refer to the abbreviations and definitions within JSP 375 Volume 3 Chapter 2.

### **K1.2 Specific definitions for the Petroleum Chapter.**

#### **AE Petroleum (AE PET)**

As defined with JSP 375 Volume 3 Chapter 2, but with specialism in petroleum.

#### **AP Petroleum (AP PET)**

As defined with JSP 375 Volume 3 Chapter 2, but with specialism in petroleum.

#### **Bulk Fuel Installation (BFI)**

An installation where large quantities of fuel, normally aviation fuel, are stored, quality checked and dispensed to a consumer.

#### **Classes of Petroleum Products**

The following are in accordance with current guidance: -

Class I: Liquids that have a flash point below 21 degrees C.

Class II: Liquids that have a flash point from 21 to 55 degrees C inclusive.

Class III: Liquids that have a flash point above 55 degrees C up to and including 100 degrees C.

Unclassified: Liquids that have a flash point above 100 degrees C.

See annexes G and H for further examples and guidance; always reference the specific safety data sheet (SDS or MSDS) for the product handled.

#### **Cold Work**

Cold work includes the use of tools for erection, dismantling and cleaning, which are not liable to produce incendive sparks, and work such as drilling, tapping and cutting carried out in such a way as to limit the heat produced and keep the temperature of the tools and work area below 100 degrees C.

#### **Combustible**

Combustible refers to any substance solid, liquid or gas that is able to catch fire and burn easily.

#### **Confined Space**

A confined space is a place which is substantially enclosed (though not always entirely), and where serious injury can occur from hazardous substances or conditions within the space or nearby (e.g. lack of oxygen).

#### **Dangerous Fumes**

Fumes in a concentration, or mixture with air, of an obnoxious, harmful or dangerous nature, arising from gases or vapours generated from products and materials, from welding and the use of heat-generating tools or the application of protective coatings, particularly in unventilated spaces.

### **Dangerous Occurrence**

An incident that may give or has given rise to; injury to person or damage to plant and/or equipment, as defined by RIDDOR.

### **Demarcation**

Reference should be made to: JSP 375 Volume 3 Chapter 2 - Allocation of Responsibilities and Demarcation Agreements and Chapter 5 section 3.3 Demarcation Agreements.

A demarcation is defined as the transfer of control of the significant risk from one organisation to another, which then gives the term the 'demarcation point'. Demarcation agreements should be established, defined by drawings or other means and recorded; the demarcation document should be signed and dated by all affected parties.

### **Down Wind Boundary (DWB)**

Furthest point of the restricted area and located down wind of the point of work or release of petroleum product, point of monitoring with MGI/CGI to ensure that there is no explosive vapour.

### **Electrical Testing**

Electrical testing within hazardous areas is defined within BS EN 60079 part 17; a summary of the three inspection criteria is given below:-

#### **Visual inspection**

Inspection which identifies, without the use of access equipment or tools, those defects, such as missing bolts, which will be apparent to the eye

#### **Close inspection**

Inspection which encompasses those aspects covered by a visual inspection and, in addition, identifies those defects, such as loose bolts, which will be apparent only by the use of access equipment, for example steps, (where necessary), and tools

Note: Close inspections do not normally require the enclosure to be opened, or the equipment to be de-energized.

#### **Detailed inspection**

Inspection which encompasses those aspects covered by a close inspection and, in addition, identifies those defects, such as loose terminations, which will only be apparent by opening the enclosure, and/or using, where necessary, tools and test equipment

### **Flammable (Synonymous with Inflammable)**

Refers to any substance, be it a solid, liquid, gas or vapour, which in the presence of air, is easily ignited. The addition of the prefix 'non' shall indicate that the substances are not readily ignited, but does not necessarily indicate that they are non-combustible. See also 'Combustible'.

### **Flashpoint**

The lowest temperature at which a liquid gives off sufficient vapour in air to form a flammable mixture. (*Recommendations on the design and operation of fuel storage sites. Buncefield Major Incident Investigation Board, 2007*).

The flashpoint of a liquid is an important and practical flammability characteristic, and is one of the main properties used to determine fire and explosion hazard. The flashpoint is defined as, the lowest temperature, corrected to a pressure of 101.325 kPa, at which a liquid evolves vapours, under the conditions defined in the test method, in such an amount that a flammable vapour/air mixture is produced in the test vessel. It should be noted that at the flashpoint, continuous combustion does not occur; this takes place at a higher temperature commonly referred to as the 'fire point'. (*HSE Guidance Note CS24, now replaced by ASRM MNL72*).

### **Gas**

A term used in accordance with the practice of the Petroleum Industry and MOD, for example, in gas detection. The term is also used to describe petroleum vapours, and the residual vapour in tanks that must be removed before tank entry.

### **Gas Concentration**

A concentration of gas expressed as a percentage of the Lower Explosive Limit.

### **Gas detector**

An indicator designed to measure the concentration of Hydrocarbons, Oxygen, and other gases, such as Hydrogen Sulphide (H<sub>2</sub>S), depending on the requirement and the type of sensors fitted. This will encompass a number of variations of meters available, including Multiple Gas Indicators (MGIs), combustible or flammable gas indicators (CGIs). See also 'response test'.

### **Gas-Free**

An environment is said to be gas free when the following conditions are all met:

- a. A gas test shows that the concentration of gas is below 1% of the Lower Explosive Limit
- b. When it is free from all fuel and residues
- c. When it is free from vapour drift from any source.

### **Hazardous Area (because of petroleum explosive vapour atmospheres)**

The term 'hazardous area', on the MOD Estate, can be used in a context to define two separate states with regard to a petroleum asset.

1. The area surrounding a location or petroleum asset as defined and specified by the OA / Hazardous Area Manager / or other representative of the establishment and which is indicated by fences, notices or other means. Within this boundary will be contained the DSEAR 'Hazardous Area' and possibly areas that would be deemed non-hazardous. This area will normally be subject to access control measures and key control.
2. Hazardous Areas are defined in DSEAR as "any place in which an explosive atmosphere may occur in quantities such as to require special precautions to protect the safety of workers". Work in this area will require control measures put in place to control the risk, such as a permit to work.

Non-hazardous area (because of explosive gas atmospheres): *an area in which an explosive gas atmosphere is not expected to be present in quantities such as to require special precautions for the construction, installation and use of equipment.*

Examples of sub-assets within the fenced area but outside the physical hazardous area may be the control/rest room within a bulk fuel installation (BFI).

Refer also to 'Restricted Area'. The 'Restricted Area' may extend beyond the defined or fenced area of a petroleum installation. For example, when tank venting.

### **Hazardous Area Manager**

A person having control of works and other defined responsibilities within a petroleum hazardous area. Refer also to OA.

### **Hot Work**

This includes welding, the use of any flame or electric arc, and the use of any equipment likely to cause heat, flame or incendive sparks including non-certified electrical equipment. It also includes caulking, chipping, drilling, riveting and any other heat-producing operation, unless it is

carried out in such a way as to keep the temperature of the tools and the work below 100 degrees C, whilst also preventing the creation of incendive sparks.

### **Hydrogen Sulphide, H<sub>2</sub>S**

A gas which is very toxic on inhalation and highly flammable.

### **Incendive Spark**

A spark of sufficient temperature and energy to ignite a flammable gas/vapour

### **Lead**

A toxic alkyl compound (tetraethyl lead or tetra methyl lead), which may be present in gasoline and is still added to aviation gasoline, refer to the Manufacturer's/Material Safety Data Sheet (MSDS).

### **Lead-Free**

- a. Any tank, vessel or equipment that at no time has contained gasoline. Note that so-called unleaded gasoline contains lead, and tanks that contain that product can therefore not be classed as lead free.
- b. Any tank, vessel or equipment which has contained leaded fuel and the whole of which has been blast cleaned and internally epoxy coated and is free from damage.

### **Lower Explosive Limit (Synonymous with Lower Flammable Limit), LEL, LFL**

The percentage by volume of gas in a mixture of gas and air below which no explosion will take place, the minimum concentration needed for ignition, hence below this will not ignite with the application of an ignition source. Refer also to Flash point and upper explosive limit.

### **Joint checks**

This is a specific requirement for the monitoring of combustible gases, oxygen levels and other gases by both the AP and the PiC with two appropriate gas indicators/monitors and recording of the highest reading of the two readings on the permit or other document as required.

### **Mechanical Transport Fuelling Installation (MTFI)**

Filling and Service Stations (Kerbside Pump Installations), installations for the receipt, storage and issue of petroleum products directly into the fuel tanks of vehicles for the sole use of those vehicles, and for the occasional filling of portable containers.

### **Multiple Gas Indicator, (MGI)**

See Gas Detector.

### **Operating Authority, (OA)**

Used to represent the line manager (either RN, RAF, Army, USVF or civilian body) having total control of the operation of a petroleum installation, filling and service station or plant storage facility. Refer to JSP 317.

### **Personal Protective Equipment, (PPE)**

Overalls, headgear, eye protection, footwear, gloves, and other equipment intended for the protection of personnel against contamination by petroleum products. Type and grade subject to task being undertaken and risk assessment in accordance with 'Personal Protective Equipment at Work Regulation 1992' and Annex 'D'.

### **PET**

General abbreviation for petroleum used throughout this document, for example, AP Petroleum, and petroleum installation, to emphasise the source of the hazard to maintenance operations. May also be known as POL – Petrol Oil Lubricant.



### **Petroleum Installations Operating Record (PIOR)**

A site record listing significant events associated with Petroleum Installations in a chronological order.

### **Petroleum Installations Document Register (PIDR)**

A site-specific register containing relevant details associated with the Petroleum Installations and safe system of work on the establishment – this forms part of the document centre.

### **Petroleum Safety Rule Book**

A booklet that is to be issued to all skilled persons to enable them to become familiar with the requirements of the MOD Safety Rules and Procedures and a reference when conducting works in hazardous areas (petroleum). This booklet should not be used as a standalone document.

### **Product Receipt Enclosure (PRE)**

Enclosure normally located at the site boundary where fuel is received in to the site via the Government Pipeline or Sub-sea pipeline from tankers.

### **Response test**

This is the testing prior to use of the gas detector (MGI), used to monitor a space is free from flammable gas, correct oxygen level and other duties as required. The response test will be carried out using a known gas. Manufacturer's instructions must be consulted.

### **Restricted Area**

A temporarily defined area, normally but not necessarily in a hazardous area, in which, owing to the nature of the work to be undertaken, a release of petroleum product or liquid is possible thus giving rise to an increased risk of:

- a. Fire.
- b. Explosion.
- c. Asphyxiation.
- d. Poisoning from toxic sludge, fumes, gas or dust.

### **Respirator**

See RPE equipment.

### **Respiratory Protective Equipment, (RPE)**

Respiratory Protective Equipment selection of type equipment subject to assessment in accordance with 'Personal Protective Equipment at Work Regulation 1992' and 'HSG 53', for further information refer to Annex 'D', all equipment must have Health and Safety Executive approval and CE marked.

### **Rescue Line**

A line used in conjunction with a safety rescue harness.

### **Resuscitation Apparatus**

A portable apparatus for supplying oxygen, to assist resuscitation; for use only by specifically trained personnel.

### **Safety Key Box (SKB)**

SKBs are secure boxes with either two unique locks or one unique lock and the facility to fit a multi-hasps. Refer JSP 375 Volume 3 Chapter 2 Section 4.3.

### **Safety Lock (SL)**

Safety Locks are padlocks indelibly painted red having only one key that is different from all other keys in use. Each SL is to be marked with a unique identification number and its key is to be labelled with the same number. When the SLs are in use, the safety keys are to be kept in a Safety Key Box (SKB).

**Safety Rescue Harness**

A harness worn when working in a tank or confined space to facilitate the removal of the wearer in an emergency. Used in conjunction with a safety line.

**Senior Authorising Authority Petroleum (SAA Pet)**

As defined within JSP 375 Volume 3 Chapter 2, but with specialism in petroleum.

**Sullage**

Also known as 'Bilge Water' collects from a ships deck and may contain water, fuel, oil, urine, detergents, solvents, chemicals, pitch, particles, and so forth and should be regarded as hazardous. A main hazard may be Hydrogen Sulphide (H<sub>2</sub>S).

**Upper Explosive Limit (UEL or UFL)**

Also known as upper flammability limit, where the concentration of gas reaches its highest concentration in air to burn when introduced to an ignition source. Once this concentration is exceeded the gas mixture will not burn, as the gas concentration in air is too rich. See also flash point and lower explosive limit.

# **PART 3**

# **MODEL FORMS**

**PET 01 - Petroleum Installation Operating Record (PIOR)**

Date & Time of Operation	Location & Identity of Equipment	Event Or Operation and Reason	Signature

Rule off each entry

Page No

**PET 02 - AP Risk Assessment**

RISK ASSESSMENT & CONTROL				Risk Assessment No: <i>Unique reference number</i>			
Site:		Location:		Sheet No:      of		Date	
Activity: <i>Description of work to be carried out</i>							
Significant Hazards	Applicable To (Persons affected)	Risk Rating Before Control Measure		Control Measures	Risk Rating After Control Measure		
		High (tick)	Low (tick)		High	Low	
<i>Significant Hazards listed here</i>	<i>Person at risk – consider all</i>			<i>List those control measures in</i>			
<i>including any other work being</i>	<i>carrying out the work</i>				<i>place to mitigate the identified</i>		
<i>undertaken in the vicinity.</i>				<i>hazards</i>			
Further Considerations:							
Task Method Statement Required	Yes [ ]	No [ ]	OA permission Required	Yes [ ]	No [ ]		
COSHH Assessment Required	Yes [ ]	No [ ]	Manual Handling Assessment Required	Yes [ ]	No [ ]		
Confined Spaces Assessed	Yes [ ]	No [ ]	Electrical Permit Required	Yes [ ]	No [ ]		
Other – Please specify	Yes [ ]	No [ ]	Asbestos insulation or gaskets	Yes [ ]	No [ ]		
Assessment carried out by:				I have read, understood and will implement all control measures indicated on this Risk Assessment			
Signed: Name:				Signed:.....			
Date:.....				Name:.....			
For .....				Date:.....			
				For and on behalf			
				of.....			

**Book No.....(PRE-PRINTED)..**  
**Serial No.....(PRE-PRINTED)..**

**PET 03 - Safety Programme**

Site: \_\_\_\_\_ Location: \_\_\_\_\_ AP Risk Assessment No: \_\_\_\_\_

**Part 1 To be completed by the Authorised Person (Petroleum):**

The type of installation \_\_\_\_\_  
 \_\_\_\_\_  
 \_\_\_\_\_

The proposed works are on the following installations and equipment:  
 \_\_\_\_\_  
 \_\_\_\_\_  
 \_\_\_\_\_  
 \_\_\_\_\_

The proposed time and date for start and completion of work:

Start Time & Date \_\_\_\_\_ Completion Time & Date: \_\_\_\_\_

Product		Class		Leaded	Yes/No*	Toxic	Yes/No*
Maximum Permissible Gas Concentration	Identified in Work Sequence	Permissible Oxygen Level	Min 19% - Max 22%				
Other Gas Identified..... Maximum Permissible Gas Concentration		Associated Safety Documentation					
Respiratory Protective Equipment required	Yes/No*	Type identified in Work Sequence	Personal Protective Equipment required	Yes/No*	Type identified in Work Sequence		
Ventilation required	Yes/No*	Type identified in Work Sequence	Additional Safety Equipment	Yes/No*	Type identified in Work Sequence		

\* Delete as necessary

Signed: \_\_\_\_\_ (AP) \_\_\_\_\_ Time & Date: \_\_\_\_\_

Name (Print): \_\_\_\_\_ Telephone: \_\_\_\_\_

In the employ of: \_\_\_\_\_

**Counter Signature**

Signed: \_\_\_\_\_ Time & Date: \_\_\_\_\_

Name (Print): \_\_\_\_\_ Telephone: \_\_\_\_\_

In the employ of: \_\_\_\_\_ Appointment \_\_\_\_\_

**Part 2 Authorisation**

As Operating Authority I declare that the work can be carried out.

Name (Print): \_\_\_\_\_ Signed: \_\_\_\_\_ Time & Date \_\_\_\_\_

**Part 3 Work sequence**

Entry No	Location & Identity of Installation, Valve or Component Part	Event or Operation & Reason	Max LEL	RPE	PPE	Additional Items required	Date & Time of Operation

**Part 3 Work sequence (Continued)**

Entry No	Location & Identity of Installation, Valve or Component Part	Event or Operation & Reason	Max LEL	RPE	PPE	Additional Items required	Date & Time of Operation



**Part 4 Cancellation**

As Authorised Person Petroleum I declare that permits associated with this safety programme have been completed or stopped and have been cancelled and the system has been visually inspected for integrity.

This Safety Programme is hereby cancelled.

Name (Print):

Signed:

Time & Date

**Part 5 Return of Installation**

As Operating Authority I confirm the return of the installation for normal operations.

Name (Print):

Signed:

Time & Date

**NOTES**

- (a) The Operating Authority is to authorise the work by signing at part 2 of the Safety Programme.
- (b) The Operating Authority is the duty holder for the petroleum installation in accordance with JSP 317.
- (c) The Safety Programme is not complete until the proposed work sequence has been implemented and dated.
- (d) A copy of this Programme is to be issued to the Operating Authority on authorisation and retrieved at completion of task.
- (e) The cancelled original of this Programme is to be filed in the Document Register.
- (f) Unused lines in the Work sequence are to be marked through with diagonal lines.

**PET 04 - Permit to Work Petroleum**

Site:		Location:		Equipment:																			
Safety Programme No:		Safety Programme Entry No.	Task Risk Assessment No:		Safety Key Box No:																		
Associated Safety Documentation:																							
Validity from:	hrs	Date:	Validity to:	hrs	Date:																		
Contact No.	Fire:	Med:	OA:	AP:	PiC:																		
<p><b>Part 1 Authorisation</b>          The works to be carried out are as follows .....</p> <p>.....</p> <p>.....</p> <p>.....</p> <p>.....</p>																							
<p><b>Initial Gas Concentration Monitoring</b></p> <table border="1" style="width:100%; border-collapse: collapse;"> <tr> <td style="width:15%;">Max Gas level Permissible</td> <td style="width:15%;">%LEL</td> <td style="width:15%;">Oxygen level Permissible</td> <td style="width:15%;">19-22%</td> <td style="width:15%;">Other Gas .....</td> <td style="width:15%;"></td> </tr> <tr> <td>Initial Gas level POW</td> <td>%LEL</td> <td>Initial Oxygen POW</td> <td>%</td> <td>Other Gas POW</td> <td></td> </tr> <tr> <td>Initial Gas level DWB</td> <td>%LEL</td> <td>Initial Oxygen DWB</td> <td>%</td> <td>Other Gas DWB</td> <td></td> </tr> </table>						Max Gas level Permissible	%LEL	Oxygen level Permissible	19-22%	Other Gas .....		Initial Gas level POW	%LEL	Initial Oxygen POW	%	Other Gas POW		Initial Gas level DWB	%LEL	Initial Oxygen DWB	%	Other Gas DWB	
Max Gas level Permissible	%LEL	Oxygen level Permissible	19-22%	Other Gas .....																			
Initial Gas level POW	%LEL	Initial Oxygen POW	%	Other Gas POW																			
Initial Gas level DWB	%LEL	Initial Oxygen DWB	%	Other Gas DWB																			
<p>I am in receipt of and have reviewed the above Task Risk Assessment including the control measures and the task method statement. Where necessary I have carried out, with the Person in Charge, initial gas concentration checks at the Point of Work (POW) and where a restricted area has been set up the Down Wind Boundary (DWB). I confirm that the work can be carried out as authorised above in accordance with the MOD Safety Rules and Procedures, subject to these conditions being maintained.</p> <p>Name (print) ..... Signature..... Time &amp; Date.....</p> <p>Authorised Person</p>																							
<p><b>Part 2 Acceptance</b></p> <p>I accept responsibility for controlling the works detailed in Part 1. I have reviewed the above Safety Programme and have been shown all aspects of the isolation and have been issued the Safety Box Key. Where necessary I have carried out with the Authorised Person, initial gas concentration checks at the Point of Work (POW) and where a restricted area has been set up at the Down Wind Boundary (DWB). I confirm that no attempt will be made by me or any person under my control to carry out work not authorised on this permit.</p> <p>Name (print) ..... Signature..... Time &amp; Date.....</p> <p>Person in Charge</p>																							
<p><b>Part 7 Completion</b></p> <p>I declare that all persons, equipment, tools and instruments under my control have been withdrawn and that the works detailed in Part 1 have been:</p> <p><b>*(a) satisfactorily completed.</b></p> <p><b>*(b) stopped and abandoned</b> and that the system has been made safe pending further works, the reasons for stopping the work and the actions taken are detailed in Part 6 overleaf.</p> <p>Name (print) ..... Signature..... Time &amp; Date.....</p> <p>Person in Charge</p>																							
<p><b>Part 8 Cancellation</b></p> <p>I declare that the works detailed in Part 1 have been completed/stopped* and that the permit is cancelled.</p> <p>Name (print) ..... Signature..... Time &amp; Date.....</p> <p>Authorised Person</p>																							

\* Strikethrough as appropriate

Part 3 Gas Concentration Monitoring							
Repeat Test	Test Location	Time	Date	Gas % Level	O <sub>2</sub> % Level	Other Gas .....	AP Signature PiC Signature
Test 1							
Test 2							
Test 3							
Test 4							
Test 5							
Test 6							
Test 7							
Test 8							
Test 9							
Test 10							

Continued on Gas Concentration Monitoring Form(s).....

Part 4 Suspension							
The Authorised Person & Person in Charge are to ensure the site is left in a safe condition and record the date and time of the suspension.							
Date	Time	PiC Signature	AP Signature	Date	Time	PiC Signature	AP Signature

Part 5 Handover / Reaffirm							
If the Authorised Person or the Person in Charge are to change or if the job is to re-start after an overnight shutdown, then joint checks must be carried out and recorded (including gas reading) to establish that the conditions at part 1 of this permit can still be met.							
Once the joint checks are completed satisfactorily the oncoming Authorised Person and Person in Charge must sign below to affirm the authorisation and acceptance of safety rules and procedures appertaining to this permit.							
This Permit is Reaffirmed				Authorisation of AP		Acceptance by PiC	
From		To		Name	Signature	Name	Signature
Time	Date	Time	Date				

Part 6 Stopped Works
The following are reasons for stopping the work and the actions taken:
.....
.....
.....
.....

**PET 05 - Standing Instruction Petroleum**

<b>Site / Establishment:</b> .....	<b>Serial No:</b> Pre-Printed) .....
Person in Charge: ..... In the Employ of:..... Issue Date: ..... Expiry Date: ..... (Not more that 3 years from issue) Location and identity of the petroleum equipment: .....	
<p><b>Part 1 Authorisation</b>          Tasks and/or Operations to be undertaken on the equipment specified above:</p> <p>1) .....          2) .....          3) .....          4) .....</p> <p>Circumstances, under which the above tasks or operations are to be undertaken, and any special instructions or safety measures (including task risk assessment and method statement numbers):</p> <p>.....          .....</p> <p>Signed: ..... (Originating Authorised Person)          Name (print): ..... Time &amp; Date .....</p> <p>In the employ of: ..... Contact Tel No. ....</p>	
<p><b>Part 2 Acknowledgement</b>          I hereby acknowledge that the above Person in Charge can carry out the tasks or operations listed on this Standing Instruction, subject to compliance with MOD Safety Rules and Procedures.</p> <p>Signed: ..... (Operating Authority)          Name (print): ..... Time &amp; Date: .....</p> <p>In the employ of: ..... Contact Tel No: .....</p>	
<p><b>Part 3 Acceptance</b>          I accept receipt of this Standing Instruction;, I have been shown the installation to which this Instruction refers and confirm that I fully understand the tasks listed above and the circumstances under which they are to be undertaken.</p> <p>Signed: ..... (Person in Charge)          Name (print): ..... Time &amp; date .....</p> <p>In the employ of: ..... Contact Tel No. ....</p>	

**Part 4 Cancellation**

I hereby declare that the work/task has been completed and the Standing Instruction is cancelled the original instruction has been returned/lost (*delete as appropriate*) with an entry having been made in the Petroleum Installation Operating Record.

Signed: ..... (Authorised Person)

Name (print): ..... Time & date .....

In the employ of: ..... Contact Tel No. ....

### PET 06 – Petroleum Works Safety Checklist

This checklist is intended to be used as an aid. Consideration should be made of any other relevant safety, technical and MOD publications; also manufacturers' instructions for completeness to enable production of required risk assessments and method statements.

	<b>If there are any deviations from the task plan or work method, then the work must be stopped; the fault/error is to be rectified prior to recommencing work.</b>	<b>Yes</b>	<b>No</b>	<b>N/A</b>
1.	Has the scope of work been clearly specified?			
2.	Is the Building or Area Manager/Operating Authority (OA) aware of the work?			
3.	Area, operational or system activities reviewed, and operations agreed to cease during the work period.			
4.	Details of installation, tank/s, drawings, operating and maintenance instructions available.			
5.	Details of product handled, Safety Data Sheet (SDS) available. Fuel classification (0, I, II, III or unclassified), additives within fuel (toxicity). Leaded product history for tank available.			
6.	AP risk assessment completed			
7.	Task risk assessment and method statement completed, by the contractor/s undertaking the work.			
8.	Safety Programme completed. Isolations clearly defined.			
9.	Safety arrangements, emergency arrangements agreed. Establishment/site safety instructions reviewed, and any other authorities informed of the forthcoming planned works. First aid, emergency resuscitation, fire fighting equipment, emergency and rescue plan and Establishment Unit Spill Response Plan (USRP).			
10.	Work period, permit validity to be agreed by all parties.			
11.	Arrangements in place for removal of product, including final tank bottoms.			
12.	Cathodic protection to tank or pipework – ensure isolation applied in accordance with manufacturer's instructions.			
13.	Isolations appropriate for the task, clearly specified on the Safety Programme. This includes mechanical (valves/blanks/spades) and electrical isolations (pumps and heaters).			
14.	Isolations correctly implemented.			
15.	Are the right people aware of the isolated equipment?			
16.	Named person to be appointed as person in charge, as submitted by the employing company, including all certification and stated as competent to carry out the task by the employing company. Petroleum/Confined Space training Medical Fire Training First Aid			
17.	Skilled persons, as submitted by the employing company, including all certification and stated as competent to carry out the task by the employing company. Petroleum/Confined Space training Medical Fire Training First Aid			
18.	Skilled Persons' appointment procedures completed. Safety rule books issued and signed for.			
19.	Actions required in case of emergency, telephone numbers and points of contact.			
20.	All tools and equipment to be used, listed and accompanied with appropriate certification as fit for use, as issued by the contractor / end user, which will include, but			

	<b>If there are any deviations from the task plan or work method, then the work must be stopped; the fault/error is to be rectified prior to recommencing work.</b>	<b>Yes</b>	<b>No</b>	<b>N/A</b>
	not limited to, the following: - PPE. Clothing, footwear, non-static, including under garments. RPE. Face masks, hoses, cylinders, canisters. Compressor for breathing air, diesel driver and its fuel. Safety equipment, rescue harnesses, life-lines, tripod. Multiple gas indicators (MGIs / CGIs). Warning notices. Lighting equipment.			
21.	Site layout, access and egress routes agreed. Clearly defined restricted areas, wash down areas, dirty and clean clothing areas and welfare facilities.			
22.	Wash down facilities, and welfare facilities correctly placed.			
23.	All cross-bonding / earthing in place and satisfactory.			
24.	Weather, wind direction considered.			
25.	Drains, sewers blanked. Interceptors fit for purpose.			
26.	Are users briefed on the permit-to-work, and have they acknowledged understanding of requirements.			
27.	Tank / valve pit or other confined space (petroleum) entry – access point (manhole) acceptable, all procedures in place and working area ventilation suitable.			
28.	Ensure housekeeping and hygiene standards remain satisfactory.			
29.	Procedures in place for removing arisings / sludge.			
30.	Procedures in place for disposal of arising/sludge – waste transfer note(s) – copy to be placed on AP file.			
31.	Records kept on the use of RPE and PPE; e.g. breathing apparatus canisters.			
32.	Repair works, risk assessment, method statement.			
33.	Tank entry - Method of cleaning appropriate for the tank.			
34.	Tank entry - Removal of tank internals/equipment required.			
35.	Tank entry - All persons undertaking tank entry, standby persons and supervisor – appropriate certification received, medicals and submitted as competent by the employing company.			
36.	Tank entry - Tank ventilation is always kept running when persons are in the tank.			
37.	Tank repairs - Cleaning fluids, applications and compounds used for tank lining repair – risk assessment, COSHH assessment carried out.			
38.	Hot work, (welding, grinding) permission required.			
39.	Installation reinstatement. Process for reinstatement documented. All equipment (electrical and mechanical) to be reinstated and signed off as fit for continued use by the PiC.			